

**KLEA**  
220P  
Energy Analyzer



**POWYS**  
Energy Analyzer  
3121-3122



**User  
Manual**

**Klemsan®**

# İÇİNDEKİLER

<b>SECTION 1</b>	<b>GENERAL INFORMATION .....</b>	<b>4</b>
1.1	Device Features .....	5
1.2	Correct Usage and Conditions For Safety .....	6
1.3	Panel Definitions.....	7
1.4	Menu Structure .....	8
1.4.1	Key Functions.....	8
1.5	Four Quadrant Representation.....	11
<b>SECTION 2</b>	<b>INSTALLATION.....</b>	<b>12</b>
2.1	Preparing for Installation .....	13
2.2	Mounting.....	13
2.3	Connection Diagrams .....	14
2.3.1	3P-4W and 3p-3W Connections .....	14
2.3.2	Digital Output Connection Diagram .....	15
2.4	Dimensions KLEA 220P / KLEA 220P-DC and POWYS 3121-3122 (mm).....	15
<b>SECTION 3</b>	<b>MENUS.....</b>	<b>16</b>
3.1	Instantaneous Measurement Menus.....	17
3.2	Maximum, Minimum ve Demand Menus .....	18
3.3	Energy Meters Menu (ENERGY).....	19
3.3.1	Assigning Predefined Value for Energy Meters.....	21
3.4	Counters Menu (COUNTERS) .....	21
3.5	Settings Menu (SETTINGS) .....	23
3.5.1	Basic Settings Menu (BASIC).....	27
3.5.2	Alarm Settings Menu (ALARMS)(KLEA 220P / KLEA 220P-DC / POWYS 3121).....	28
3.5.3	Alarm Relay Settings Menu (RELAYS)(KLEA 220P / KLEA 220P-DC / POWYS 3121).....	29
3.5.4	Demand Period Setting Menu (DEMAND).....	29
3.5.5	RS485 Settings Menu (RS485) .....	29
3.5.6	Digital Input Settings Menu (DI INPUT).....	30
3.5.7	Pulse Output Settings Menu (PULSE) .....	31
3.5.8	Password Settings Menu (SECURITY) .....	31
3.5.9	Display Setup (DISPLAY) .....	31
3.5.10	Clear Menu (CLEAR) .....	32
3.6	Save, Changing Value and Approval Prosedure .....	33
3.6.1	Changing Value/Setting.....	33
3.6.2	Save Prosedure .....	34
3.6.3	Approval Prosedure.....	35
<b>SECTION 4</b>	<b>RS485 COMMUNICATION.....</b>	<b>36</b>
4.1	Readable and Writable Data .....	37
4.1.1	Status/Alarm Flags(KLEA 220P / KLEA 220P-DC / POWYS 3121) .....	47
4.2	Multiple Choice Settings via Modbus .....	49
<b>SECTION 5</b>	<b>FACTORY DEFAULT SETTINGS .....</b>	<b>50</b>
<b>SECTION 6</b>	<b>TECHNICAL SPECIFICATIONS .....</b>	<b>55</b>

## Figure

Figure 1-1	Klea 220P Front Panel .....	7
Figure 1-2	Four Quadrant Representation.....	11
Figure 2-1	Connection Diagram.....	14
Figure 2-2	Digital Output Connection Diagram .....	15
Figure 2-3	Dimensions for KLEA 220P / KLEA 220P-DC and POWYS 3121-3122.....	15
Figure 3-1	Instantaneous Measurement Menus (Reactive Power) .....	17
Figure 3-2	Instantaneous Measurement Menus (Active Power).....	18
Figure 3-3	Tariff 1 Import Active Energy Menu .....	20
Figure 3-4	Tariff 2 Export Reactive Energy Menu .....	21
Figure 3-5	COUNTER2 Menu.....	22
Figure 3-6	Alarm Example .....	28

## Table

Table 1-1	Product Features.....	6
Table 1-2	Key Functions.....	8
Table 1-3	Menu Switch-1 (Instantaneous Measurement Menus and Sub Menu) ..	9
Table 1-4	Menu Switch-2 (Energy, Counters,Harmonics and Setting Sub-menus)	10
Table 3-1	Energy Meters Menu .....	19
Table 3-2	Counters Menu Structure .....	22
Table 3-3	SETTINGS Menu .....	23
Table 4-1	Readable and Writable Data .....	37
Table 4-2	Alarm Flags .....	47
Table 4-3	Description List .....	49



**KLEA**  
220P  
**POWYS**  
3121-3122  
Energy  
Analyzer

**SECTION 1  
GENERAL  
INFORMATION**



## SECTION 1 GENERAL INFORMATION

### 1.1 Device Features

Klea 220P is designed to measure;

- Phase-neutral voltages,
- Phase-phase voltages,
- Phase current,
- Neutral current,
- Frequency
- $\cos\phi$ ,
- Power factors,
- Active powers,
- Reactive powers,
- Apperant powers,
- THDV,
- THDI,
- 1-31 current and voltage harmonics, (KLEA 220P / KLEA 220P-DC / POWYS 3121)

Besides, Klea 220P has numerous features such as ; :

- Phase loss information and sequence error display
- Determining and saving in the memory of maximum and minimum values of current, voltage, frequency,  $\cos\phi$ , power factor, THDV, THDI, active, reactive and apparent.
- Measuring current, active power, reactive power and apparent power values and saving in the memory
- Setting alarm for current, voltage ,frequency and power factor parameters. (KLEA 220P / KLEA 220P-DC / POWYS 3121)
- 2 tariff meters. These meters record Import Active, Export Active, Import Reactive, Export Reactive.
- Storing on hour counter (on hour), run hour counter (total energized time) and power interruption counter
- RS485 communication via MODBUS RTU protocol
- Digital inputs in order to start counter, 2nd tariff or run hour counter.
- Digital outputs which can be set to energy meters or counters as output parameters.
- 2 alarm relay outputs (KLEA 220P / KLEA 220P-DC / POWYS 3121)
- Avoiding unauthorized control by a 4-digit-password.

Table 1-1 Product Features

	KLEA 220P	KLEA 220P-DC (18..70 VDC)	POWYS 3121	POWYS 3122
Type of device enclosure	panel	panel	Rail Mounted	Rail Mounted
Basic measurements (V,VLL, I, IN, F, Cos $\varphi$ , PF, P, Q, S, THD)	●	●	●	●
1-31 Harmonics	●	●	●	-
Max-Min Value	●	●	●	●
Demand Values (I, P, Q, S)	●	●	●	●
On hour, Run Hour, Int	●	●	●	●
Energy Meters	2 tariffs	2 tariffs	2 tariffs	2 tariffs
Assigning alarm to the parameters	●	●	●	-
Alarm Relay	2 Qty	2 Qty	2 Qty	-
RS485	●	●	●	●
Digital Input	2 Qty	2 Qty	2 Qty	2 Qty
Digital Output	2 Qty	2 Qty	2 Qty	2 Qty
Indicators and leds	●	●	●	●
Order no	606161	606190	606305	606307

## 1.2 Correct Usage and Conditions For Safety

- Installation and wiring must be performed by authorized technicians in accordance with the instructions in the user manual. Do NOT commission the device before proper wiring.
- Make sure the device is de-energized before connecting to the mains.
- Short circuit the k-l terminals of the current transformer in another location before disconnecting the current transformers. Failing to do so will cause dangerous high voltages in the secondary terminals of the current transformers.
- Use a dry cloth to clean the device. Do NOT use alcohol, thinner or any abrasive materials.
- Make sure all wiring is properly made before commissioning the device.
- Do NOT open the device. There are no serviceable parts by the user.
- Keep the device away from humidity, water, vibrations and dust.
- It is advisable to connect a circuit breaker or an automatic fuse between the current input of the device and the mains (2 amps).



The manufacturer does NOT assume any responsibility for any undesired consequences if the above measures are NOT adhered to.

### 1.3 Panel Definitions

#### Front Panel

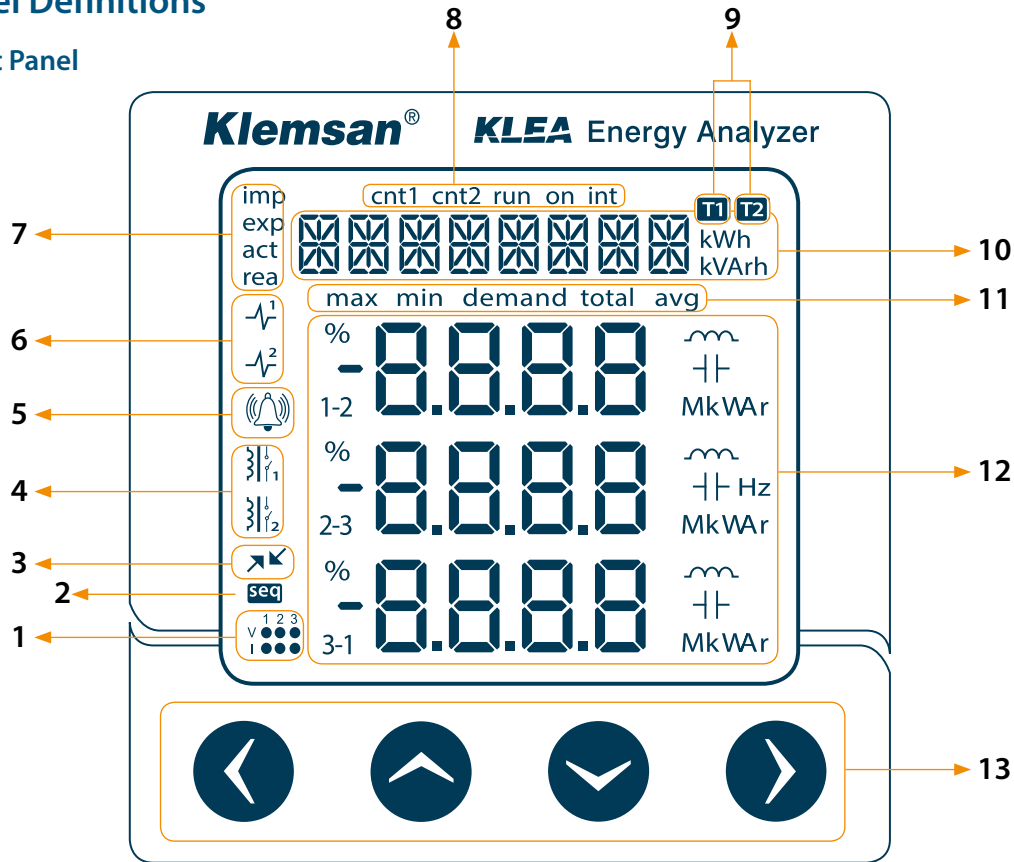


Figure 1-1 Klea 220P Front Panel

- 1 → Current and Voltage situation : Indicate phase loss of currents and voltages.
- 2 → Sequence error icon : Indicate sequence error of voltages.
- 3 → Communication active icon : Indicate that RS485 communication is made.
- 4 → Relay icons : Indicate that relays are activated.
- 5 → Alarm icon : Indicate that there is alarm on the system. (KLEA 220P / KLEA 220P-DC / POWYS 3121)
- 6 → Pulse output icons : Indicate that pulse outputs are activated.
- 7 → Energy counter icons : Indicate the type of the counter on the menu bar.
- 8 → Counter icon : Indicate the type of the counter on the menu bar.
- 9 → Tariff icons : Indicate that the counter of which tariff on the menu bar.
- 10 → Menu bar and counter units : Indicate menu names, energy counter and counters and settings.
- 11 → Submenu icons : Show that values of which submenu on the indicators.
- 12 → Indicators and units : Indicate measurements, maximum, minimum and demand values and their units.
- 13 → Keys : Use this key to switch between the menus and change the numerical values.

#### Back Panel

- I1-k1, I2-k2, I3-k3 : Current measurement inputs
- V1, V2, V3, N : Voltage measurement inputs
- D+, GND1, D : RS 485
- DI1, GND, DI2, GND : Digital Inputs
- DO1+, DO1-, DO2+, DO2- : Digital Outputs
- out1, out2 : Alarm relay outputs (KLEA 220P / KLEA 220P-DC / POWYS 3121)
- Un : Power supply



## 1.4 Menu Structure

The menus are shown instantaneous measurements menu and their maximum, minimum, demand, average and total value at the tables below. The menu pages change with up, down, right and left direction buttons.

### 1.4.1 Key Functions

The buttons placed front panel and their functions are explained at the table below.

Table 1-2 Key Functions


	At the Measurements Menus		At the ENERGY, COUNTERS, HARMONICS, SETTINGS Menus		Initialize the Counter		To change the settings	
	Short Pressing (t < 2sec)	Long Pressing (t > 2sec)	Short Pressing (t < 2sec)	Long Pressing (t > 2sec)	Long Pressing (t < 2sec)	Long Pressing (t > 2sec)	Short Pressing (t > 2sec)	Long Pressing (t > 2sec)
<b>RIGHT BUTTON</b>	Switching between menus	Skips to "ENERGY" menu	Pass to the one sub-menu	Skips to bottom menu	Changes the active step	Activates the value changing	Activates the value changing or Changes the active step	N/A
<b>DOWN BUTTON</b>	Switching between menus	N/A	Changes the menu page	N/A	değeri değiştirir	N/A	Changes the value	N/A
<b>UP BUTTON</b>	Switching between menus	N/A	Changes the menu page	N/A	Changes the value	N/A	Changes the value	N/A
<b>LEFT BUTTON</b>	Switching between menus	Skips to Starting Page	Pass to the one upper-menu	Skip to the last menu from	Stops changing value and confirms the entering value	N/A	Stops changing value and confirms the entering value	N/A



Table 1-3 Menu Switch-1 (Instantaneous Measurement Menus and Sub Menu)

	Instantaneous Value	max.	min.	demand	avg/total	avg max/total max	avg min/total min	total demand
	↕	↕	↕		↕	↕	↕	
<VOLTAGE(L-N)>	↔ VL-N ↔	↔ Max. VL-N ↔	↔ Min. VL-N ↔		↔ Avg. VL-N ↔	↔ Max. Avg. VL-N ↔	↔ Min. Avg. VL-N ↔	
	↕	↕	↕		↕	↕	↕	
<VOLTAGE(L-L)>	↔ VL-L ↔	↔ Max. VL-L ↔	↔ Min. VL-L ↔		↔ Avg. VL-L ↔	↔ Max. Avg. VL-L ↔	↔ Min. Avg. VL-L ↔	
	↕	↕	↕	↕	↕	↕	↕	↕
<CURRENT>	↔ I ↔	↔ Max. I ↔	↔ Min. I ↔	↔ Demand I ↔	↔ Total I ↔	↔ Max Total I ↔	↔ Min. Total I ↔	↔ Total Demand I ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<I NEUTR> NEUTRAL CURRENT (IN)	↔ IN ↔	↔ Max. IN ↔	↔ Min. IN ↔					
	↕	↕	↕					
<COSQ> COS Ø	↔ COS Ø ↔	↔ Max. COS Ø ↔	↔ Min. COS Ø ↔					
	↕	↕	↕		↕	↕	↕	
<PF> POWER FACTOR (PF)	↔ PF ↔	↔ Max. PF ↔	↔ Min. PF ↔		↔ Total PF ↔	↔ Max. Total PF ↔	↔ Min. Total PF ↔	
	↕	↕	↕	↕	↕	↕	↕	↕
<POWER P> ACTIVE POWER (P)	↔ P ↔	↔ Max. P ↔	↔ Min. P ↔	↔ Demand P ↔	↔ Total P ↔	↔ Max Total P ↔	↔ Min. Total P ↔	↔ Total Demand P ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<POWER Q> REACTIVE POWER(Q)	↔ Q ↔	↔ Maks. Q ↔	↔ Min. Q ↔	↔ Demand Q ↔	↔ Total Q ↔	↔ Max. Total Q ↔	↔ Min. Total Q ↔	↔ Total Demand Q ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<POWER S> APPERANT POWER (S)	↔ S ↔	↔ Max. S ↔	↔ Min. S ↔	↔ Demand S ↔	↔ Total S ↔	↔ Max. Total S ↔	↔ Min. Total S ↔	↔ Total Demand S ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<Σ P-Q-S> TOTAL POWER (Σ P-Q-S)	↔ Σ P-Q-S ↔	↔ Max. Σ P-Q-S ↔	↔ Min. Σ P-Q-S ↔	↔ Demand Σ P-Q-S ↔				
	↕	↕	↕	↕				
<FREQ> FREQUENCY(F)	↔ F ↔	↔ Max. F ↔	↔ Min. F ↔					
	↕	↕	↕					
<THD V>	↔ THDV ↔	↔ Max. THDV ↔	↔ Min. THDV ↔					
	↕	↕	↕					
<THD I>	↔ Anlik ↔	↔ Max. THDI ↔	↔ Min. THDI ↔					
	↕	↕	↕					

Table 1-4 Menu Switch-2 (Energy, Counters,Harmonics and Setting Sub-menus)

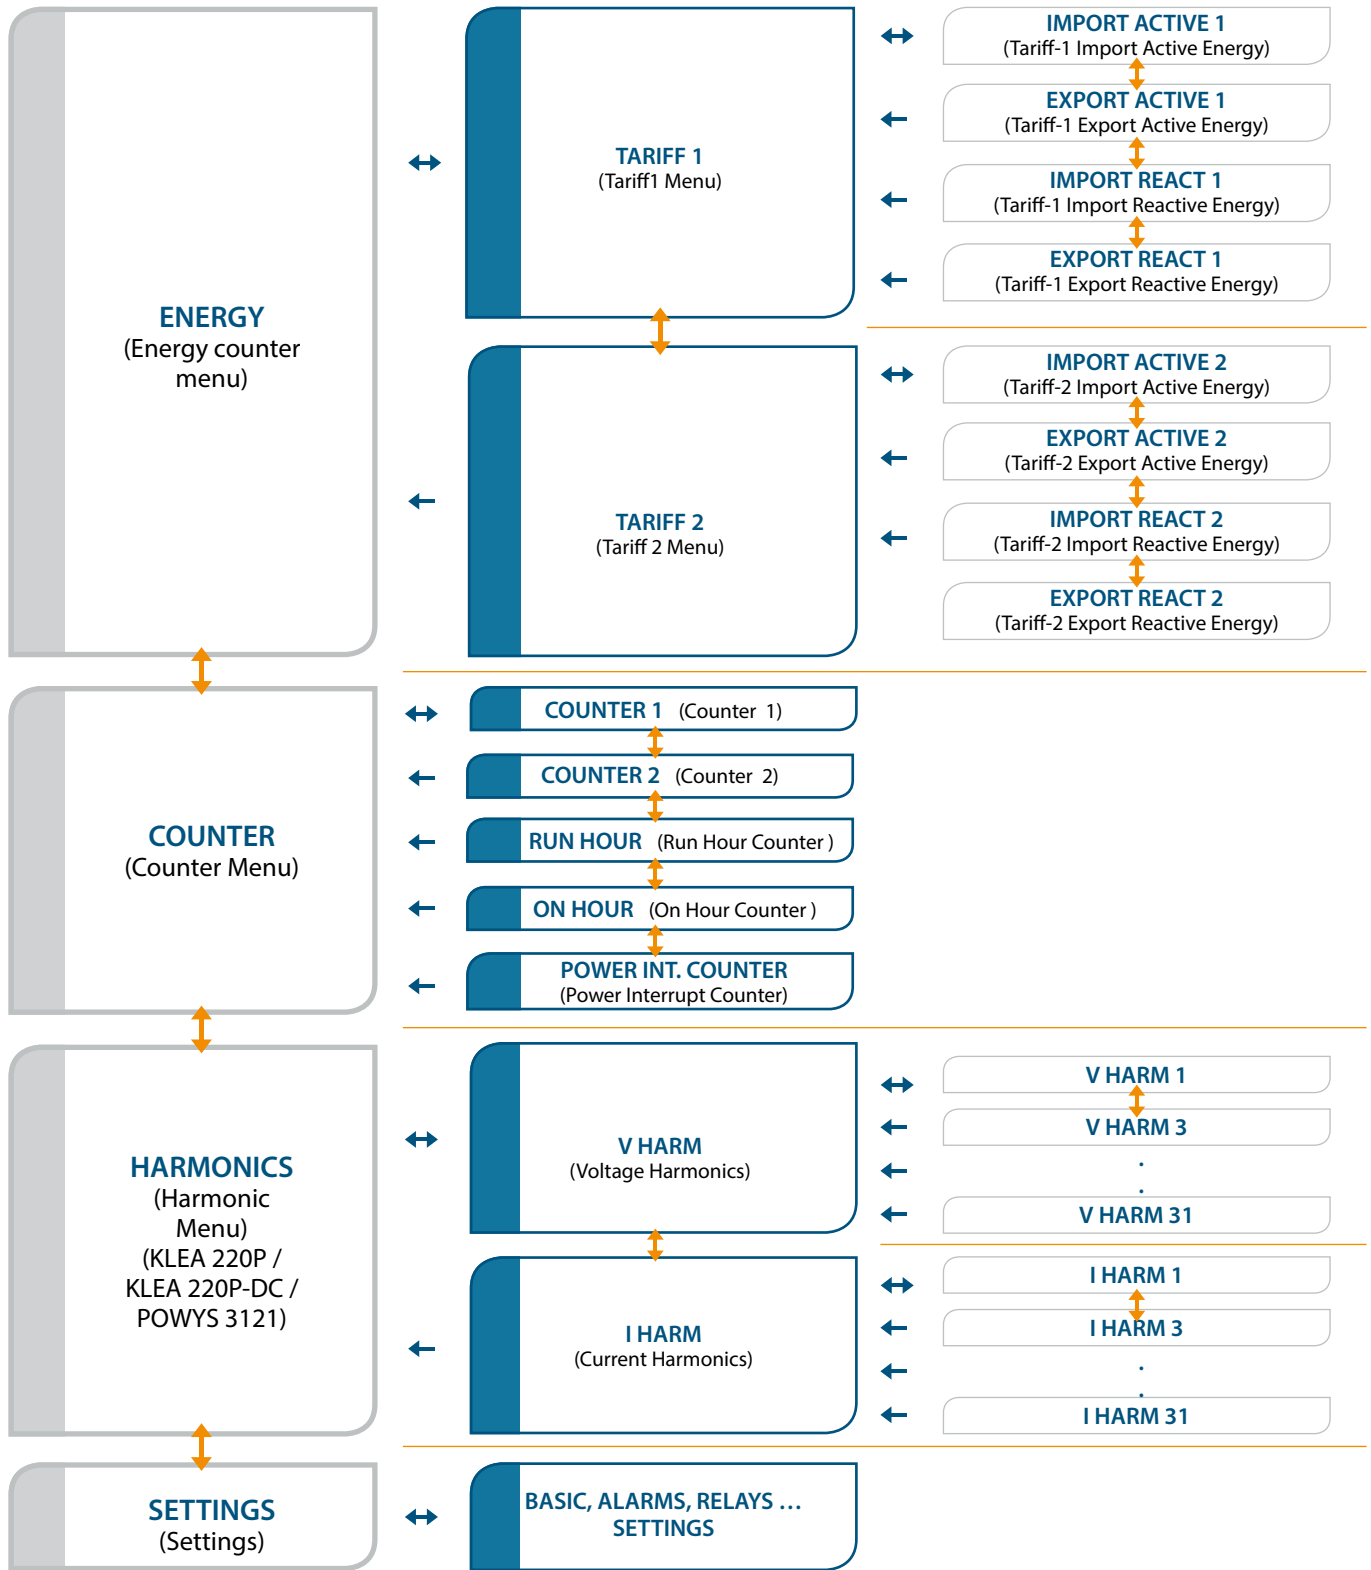

Energy counters, counters, odd harmonics up to 31st (KLEA 220P / KLEA 220P-DC / POWYS 3121) and settings menus are placed at the table above. Menu switching are made via up, down, right and left direction buttons as stated at the table.

**NOTE:** right button shall be pressed long in order to switch from Table 1-3 to Table 1-4, and



## 1.5 Four Quadrant Representation

The angle( $\emptyset$ ) between voltage and current provides us information about the direction of energy flow. A positive sign for active/reactive power indicates that active/reactive power is consumed. And also a negative sign for active/reactive power indicates that active/reactive power is generated.

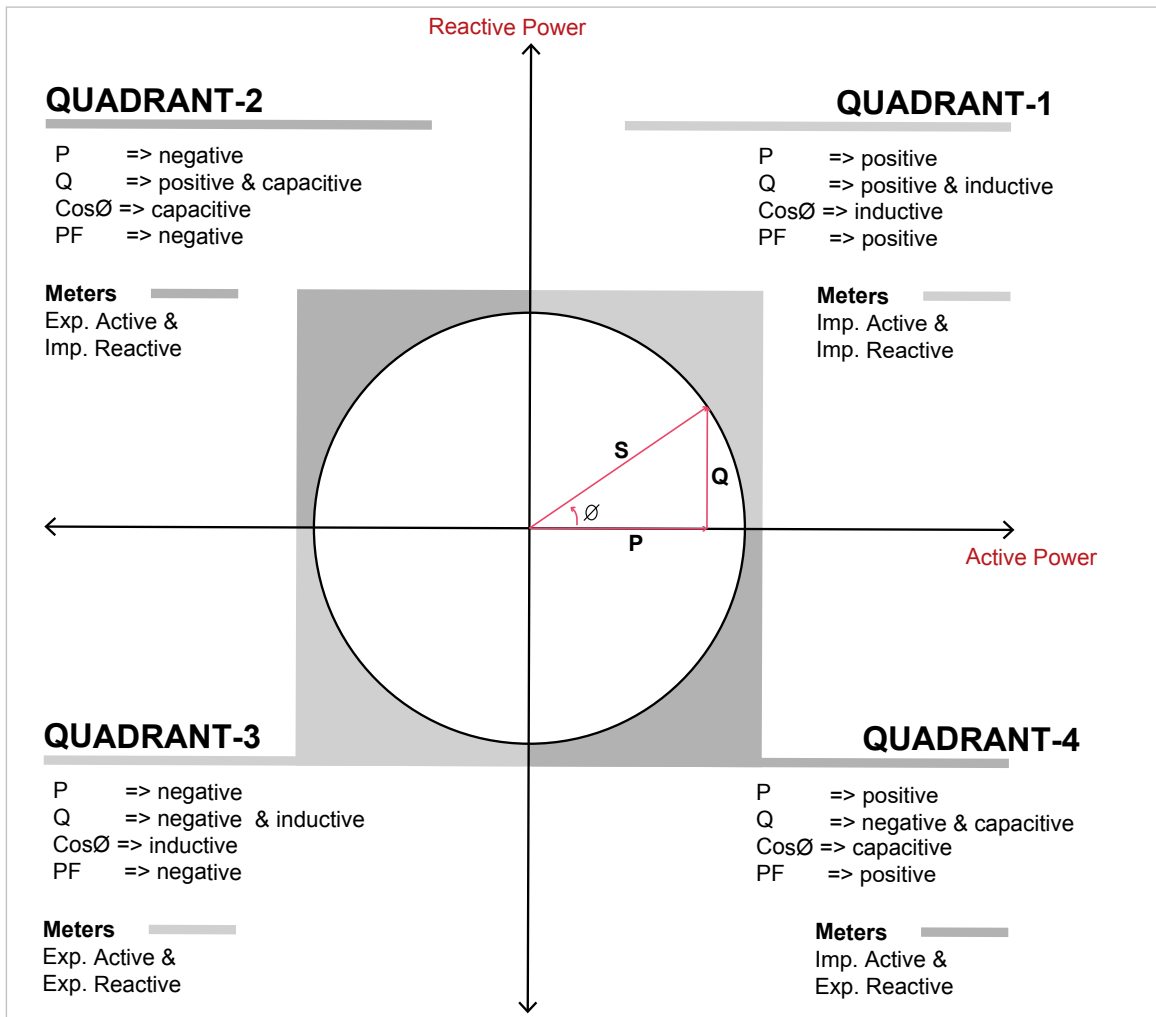


Figure 1-2 Four Quadrant Representation

**NOTE:** If the signs of active and reactive power are examined, it can be defined the quadrant that Klea measures.

In order to understand P and Q signs in Klea 110P and Ecras, instantaneous displays for P and Q must be checked.

If active power display is seem constantly, it means active power(P) is positive. If it is blinked, it means active power(P) is negative.

If reactive power(Q) display is seem constantly, it means reactive power(Q) is positive. If it is blinked, it means reactive power(Q) is negative.

**NOTE:** Signs of P and Q can be reached through modbus communication.

**E.g.;**

- P= +10kW, Q= +5kVAr => Quadrant-1
- P= -10kW, Q= +5kVAr => Quadrant-2
- P= -10kW, Q= -5kVAr => Quadrant-3
- P= +10kW, Q= -5kVAr => Quadrant-4



**KLEA**  
220P  
**POWYS**  
3121-3122  
Energy  
Analyzer

**SECTION 2**  
**INSTALLATION**



## SECTION 2 INSTALLATION

### 2.1 Preparing for Installation



Assembly and related connections of the product, must be implemented by authorized persons in accordance with the instructions of user manual.



The device must not be put into service if the operator is not sure that all connections are correctly accomplished.

### 2.2 Mounting

KLEA is placed vertically into the gap located in the panel. After the product is placed into the panel, fixing brackets should be installed on the product. After that it should be fixed to the panel wall with the screws.



Before wiring up voltage and current ends to KLEA, you must be sure that the power is cut.



The product is connected to current transformer(s). Before disconnecting current transformer leads, be sure that they are short circuited elsewhere or connected to a parallel load which has sufficiently low impedance. Otherwise dangerously high voltages will be induced at the current transformer leads. Same phenomena also apply for putting into service.



## 2.3 Connection Diagrams

### 2.3.1 3P-4W and 3p-3W Connections

There are two ways for connections of voltage and current. With neutral (3P-4W), without neutral (3P-3W).

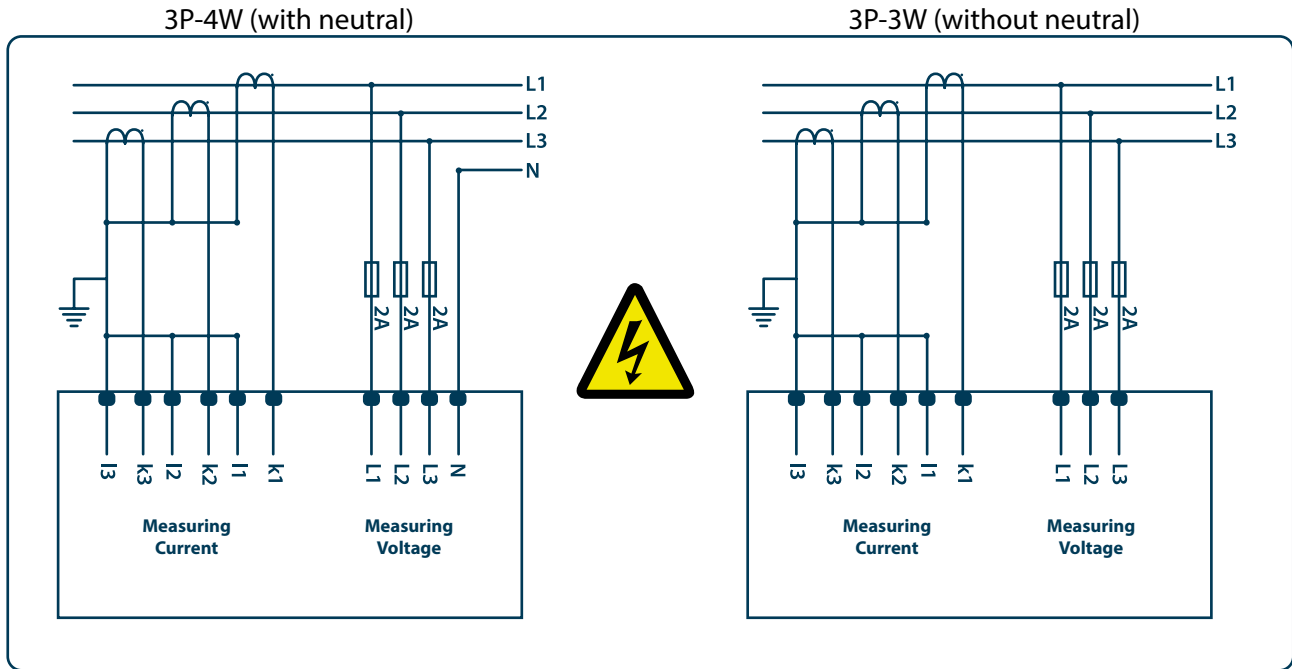


Figure 2-1 Connection Diagram



**Figure 1-1** 1st item, displays current and voltage phase position are On/Off. If a current or voltage phase seems incomplete and should be checked by the relevant links / connections reached the device.

**Figure 1-1** 2nd item, if there is an error in the voltage phase during due to incorrect sequence; "Voltage phase sequence error icon" will appear. If this icon appears; phase-sequence voltage should be checked.



### 2.3.2 Digital Output Connection Diagram

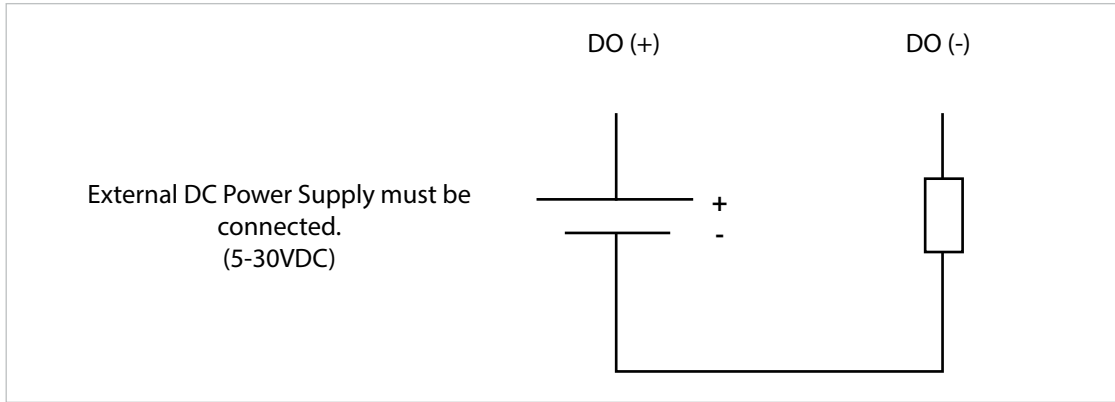


Figure 2-2 Digital Output Connection Diagram

### 2.4 Dimensions KLEA 220P / KLEA 220P-DC and POWYS 3121-3122 (mm)

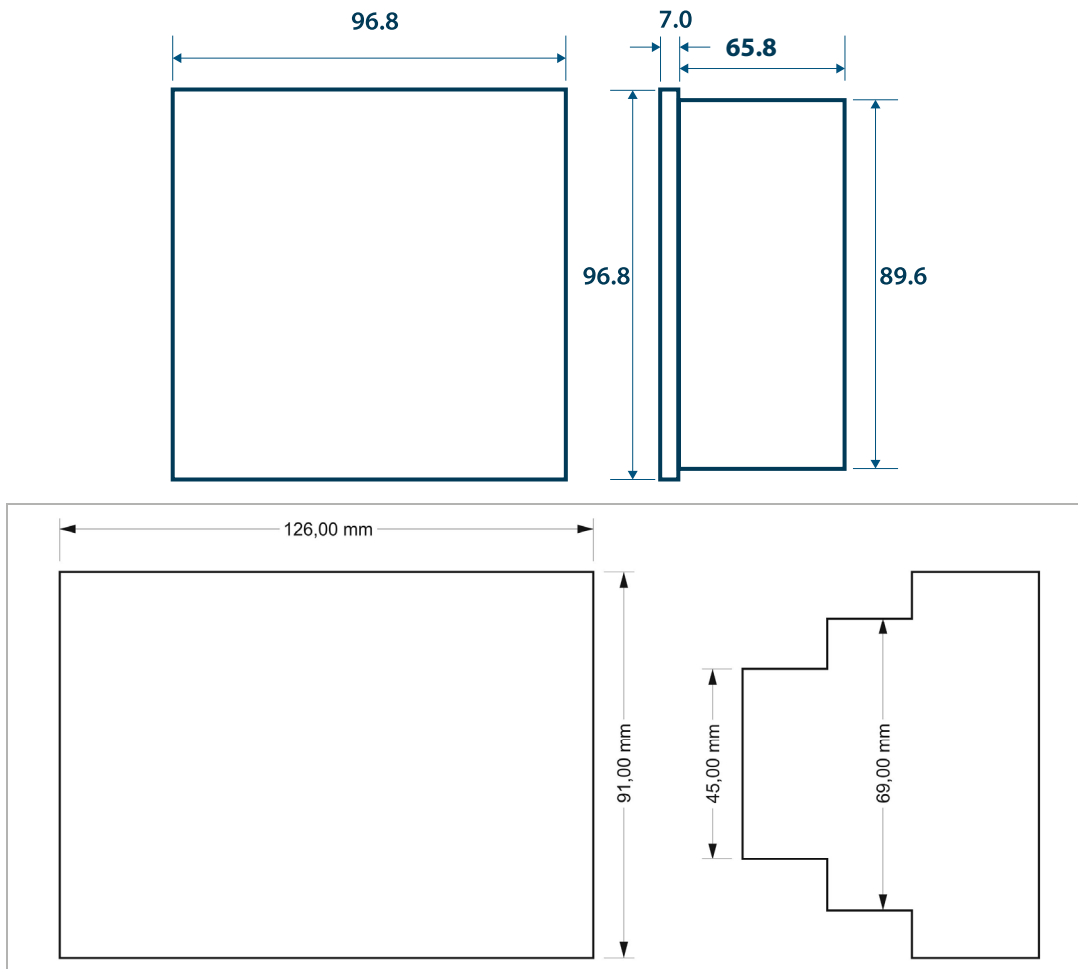


Figure 2-3 Dimensions for KLEA 220P / KLEA 220P-DC and POWYS 3121-3122



**KLEA**

220P

**POWYS**

3121-3122

Energy  
Analyzer

**SECTION 3  
MENUS**





## SECTION 3 MENUS

### 3.1 Instantaneous Measurement Menus

Voltage (L-N and L-L), current, neutral current,  $\cos\phi$ , power factor, active power, reactive power, apparent power, THDV and THDI values are shown in instantaneous menu.

Menu are given the name of which is shown in Menu bar.

The values shown on the display is expressed in what phase or phases at the lower left corner of the display numbers.

Phase Numbers are not displayed at Menus which display average, total and other properties of network. In this case phases are displayed in 2. Level.

Next to each index value unit of respective rows are indicated. It also states that inductive or capacitive phases are indicated next to the relevant indicators.

Table 1-3 for parameters displayed in the menus.

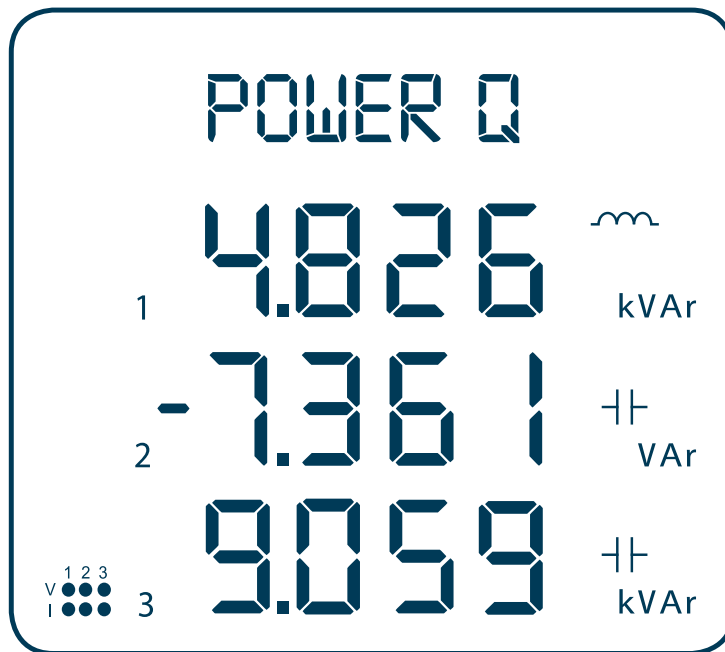


Figure 3-1 Instantaneous Measurement Menus (Reactive Power)



When the product is mounted on a panel which consumes power, active power

(P) must be positive. If active power is negative, operator should cross connect k-l leads of the current transformer.

When the product is mounted on a panel which generates power, active power (P) must be negative. If active power is positive, operator should cross connect k-l leads of the current transformer.



### 3.2 Maximum, Minimum ve Demand Menus

Minimum and maximum values are calculated and stored in the non-volatile memory for below parameters.

- Voltage (phase-neutral, phase-phase)
- Neutral current
- Frequency
- CosØ
- Power factor
- THDV
- THDI

Besides maximum and minimum values, demand values are calculated and stored in the non-volatile memory for below parameters.

- Current
- Active power
- Reactive power
- Apparent power

Table 1-3 shows the menu movements.

**NOTE:** The values held in memory can be deleted by selecting " CLEAR" menu in the "SETTINGS" menu. Reset and return to the factory settings can be made with RS 485 communication

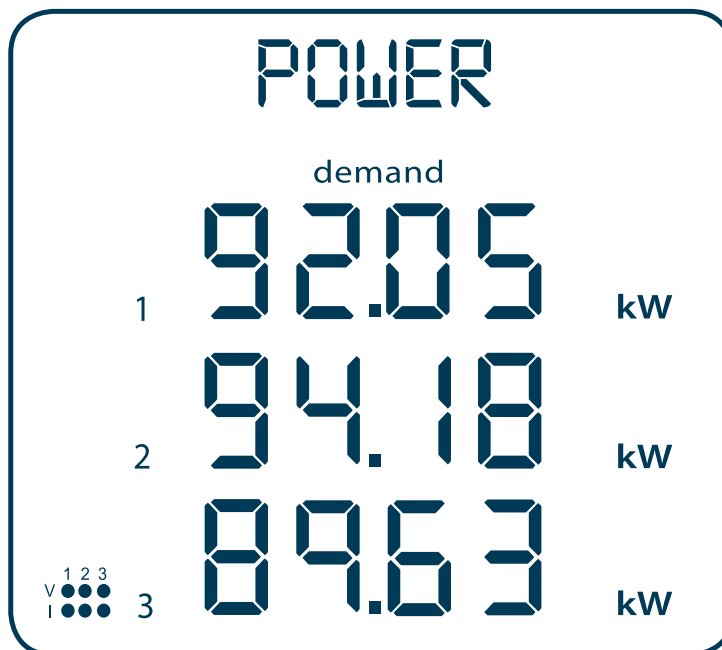


Figure 3-2 . Instantaneous Measurement Menu (Active Power)




### 3.3 Energy Meters Menu (ENERGY)

These tariffs are shown in “Enr” menu. Each tariff has import active, export active, import reactive and export reactive meters.

- Import Active Energy Meter (I.Ac)
- Export Active Energy Meter (E.Ac)
- Import Reactive Energy Meter (I.rE)
- Export Reactive Energy Meter (E.rE)

The menu structure is shown below:

Table 3-1 Energy Meters Menu

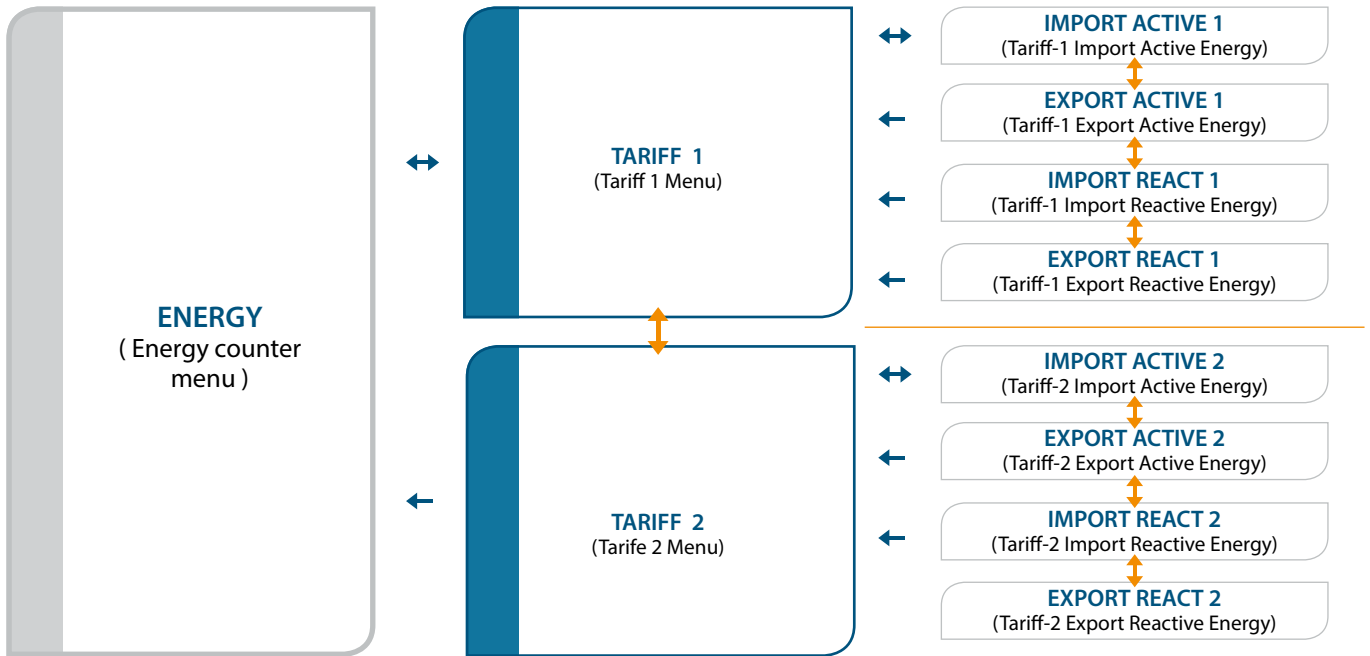

The following menu icons are active in “ENERGY” menu:

- T1** : This icon appears with Tariff 1 counters
- T2** : This icon appears with Tariff 2 counters
- imp** : This icon appears with import energy counters
- exp** : This icon appears with export energy counters
- act** : This icon appears with active energy counters
- rea** : This icon appears with reactive energy counters

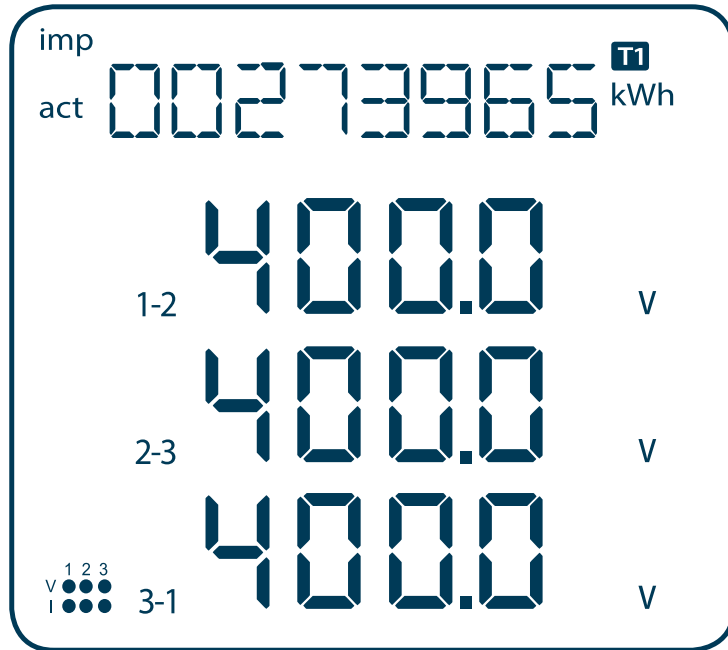


Figure 3-3 Tariff 1 Import Active Energy Menu



Counters are displayed in the format xx xxx xxx kWh / kVArh (KLEA 220P / KLEA 220P-DC / POWYS 3121-3122) (See: Figure 3-3) For Powys 3122, shown in x xxx xxx.x kWh / kVArh format. All counters are reset at 99 999 999 ( For Powys 3122; 9 999 999.9 ) kWh / kVArh and then start over from zero. It is possible to initialize the counters under the "ENERGY" menu.



To activate 2.tarif counters, firstly digital counter input type should be selected as 2.tarif ("tr2") and it must take an active position of the digital input. DI digital input becomes active when GND- ends are shorted. Otherwise 1.tarif is active.



Figure 3-4 Tariff 2 Export Reactive Energy Menu

### 3.3.1 Assigning Predefined Value for Energy Meters

In any meter menu, press and hold the right key for at least 2 seconds and the respective menu title starts blinking. Using the right arrow key, move to the digit you want to change and enter the value using the up/down arrows. When you are done entering the value, confirm using the left arrow key. Move on to the storage procedure to store the changes you made. (See: [3.6.2 Save Procedure](#))



If password protection is enabled, press and hold the right key for at least 2 sec to display the password authentication page. Enter the password to proceed to the counter assignment.


### 3.4 Counters Menu (COUNTERS)

There are counters under the “COUNTERS” menu below.

- “COUNTER1”: When a digital input 1 is assigned to a counter, it counts the changes in the digital input. The value is displayed in “COUNTER1” menu.
- “COUNTER2”: When a digital input 2 is assigned to a counter, it counts the changes in the digital input. The value is displayed in “COUNTER2” menu.
- “ON HOUR” Counts and displays the total “on” time for the device in hours.
- “RUN HOUR”: If the digital input type was set to “run hour enable”, it counts the time elapsed during the digital input is in active position. This counter requires signal from 3- phase voltage and 3-phase current inputs to function without connecting to a digital input. The measured value is displayed in hours.
- “POWER INTERRUPTION COUNTER”: Counts the power interruptions for the device.

“POWER INTERRUPTION COUNTER”: Counts the power interruptions for the device.  
 The menu structure is shown below:

Table 3-2 Counters Menu Structure

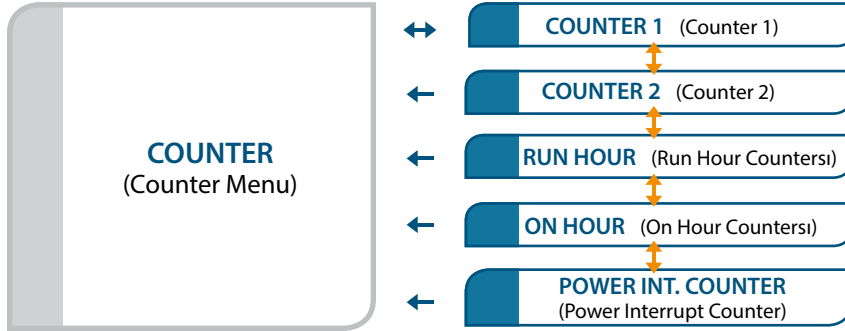

Counters showing the following icons on the “COUNTERS” menu is active:

cnt1 : This icon appears with “COUNTER1” counter.

cnt2 : This icon appears with “COUNTER2” counter.

run : This icon appears with “RUN HOUR” counter.

on : This icon appears with “ON HOUR” counter.

int : This icon appears with “POWER INTERRUPTION COUNTER” counter.

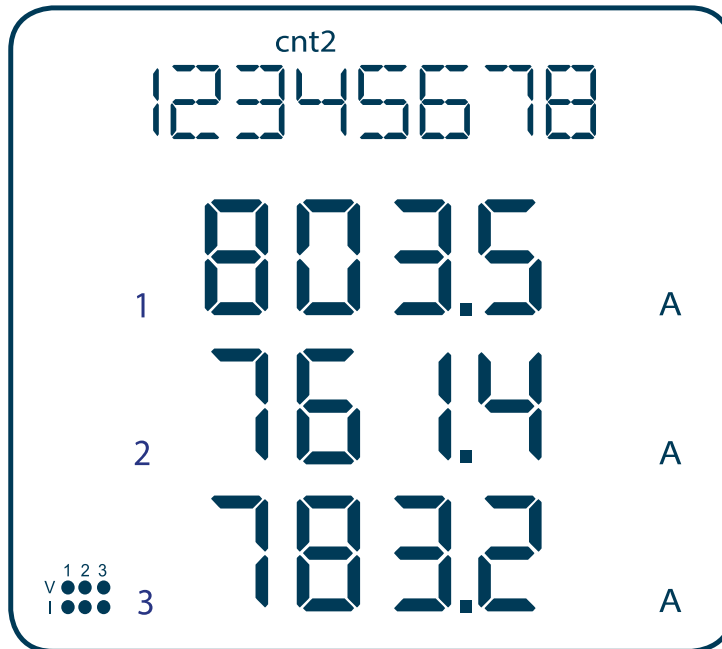


Figure 3-5 COUNTER2 Menu



Counters are displayed as 8 digits. All counters are reset at 99 999 999 and then start over from zero.

Only “COUNTER1”, “COUNTER2” and “RUN HOUR” counters can be assigned values or reset. Use the procedure for assigning default values to assign values to counters.

See: [3.3.1 Save Procedure](#)

When the energy meters are displayed instantaneously, last measured parameters (such as voltage, current, active power values etc.) are continued to display under the energy meter value as well.

### 3.5 Settings Menu (SETTINGS)

Klea settings are made in the SETTINGS menu. Table 3-3 shows the SETTINGS menu tree.

Table 3-3 SETTINGS Menu

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description		
SETTINGS					Settings		
	BASIC				Basic settings		
		Ctr				Current transformer rate	
		Utr				Voltage transformer rate	
		Conn				Connection type options	
			3P4W			3P4W connection type	
					3P3W connection type		
	ALARMS (KLEA 220P / KLEA 220P- DC / POWYS 3121-3122)					Alarm setup	
		VLN ALM				Voltage (phase-neutral) alarm setup	
			HI				Voltage (phase-neutral) alarm high limit
			LO				Voltage (phase-neutral) alarm low limit
			hYSt				Voltage (phase-neutral) alarm hysteresis value
			dIY.t				Voltage (phase-neutral) alarm delay time
		VLL ALM					Voltage (phase-phase) alarm setup
			HI				Voltage (phase-phase) alarm high limit
			LO				Voltage (phase-phase) alarm high low limit
			hYSt				Voltage (phase-phase) alarm hysteresis value
			dIY.t				Voltage (phase-phase) alarm delay time
		I ALM					Current alarm setup
			HI				Current alarm high limit
	LO					Current alarm low limit	
	hYSt					Current alarm hysteresis value	
	dIY.t					Current alarm delay time	

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description		
SETTINGS	ALARMS (KLEA 220P / KLEA 220P- DC / POWYS 3121-3122)	IN ALM			Neutral current alarm setup		
			HI		Neutral current alarm high limit		
			LO		Neutral current alarm low limit		
			hYSt		Neutral current hysteresis value		
			dIY.t		Neutral current alarm delay time		
		COSQ ALM					Cos φ alarm setup
			HI				Cos φ alarm high limit
			LO				Cos φ alarm low limit
			hYSt				Cos φ alarm hysteresis value
			dIY.t				Cos φ alarm delay time
		PF ALM					Power factor alarm setup
			HI				Power factor alarm high limit
			LO				Power factor alarm low limit
			hYSt				Power factor alarm hysteresis value
			dIY.t				Power factor alarm delay time
		FREQ ALM					Frequency alarm setup
			HI				Frequency alarm high limit
			LO				Frequency alarm low limit
			hYSt				Frequency alarm hysteresis value
			dIY.t				Frequency alarm delay time
	RELAYS (KLEA 220P / KLEA 220P- DC / POWYS 3121-3122)					Relay output setup	
		rLY1				Relay 1 setup	
			OFF				Relay 1 OFF
			LOW				Assign relay 1 to level low alarms
			HIGH				Assign relay 1 to level high alarms
		rLY2					Relay 2 setup
			OFF				Relay 2 OFF
			LOW				Assign relay 2 to level low alarms
			HIGH				Assign relay 2 to level high alarms
		DEMAND					Demand setup
	dEd.t					Demand time setup	
	RS485					RS485 setup	
		bAud				Baud rate options	
Id					Slave ID setup		
PrYt						Parity check setup	
		NONE				Parity check off	
		EVEN				Even parity	
					Odd parity		



Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description	
SETTINGS	DI INPUT	INPUT1			Digital input setup	
					Digital input 1 setup	
						Digital input 1 options
			tYPE		OFF	Off
				TARIFF 2	Enable tariff 2	
				COUNTER	Enable counter	
				RUN HOUR	Enable Run Hour	
			dLY			Digital input 1 detection delay time
			EdgE			Digital input 1 detection edge
				RISING	Detection in rising edge	
				FALLING	Detection in falling edge (Only valid for counter)	
				BOTH EDG	Detection in both edges (Only valid for counter)	
		INPUT2				Digital input 2 setup
					Digital input 2 options	
			tYPE		OFF	Off
				TARIFF 2	Enable tariff 2	
				COUNTER	Enable counter	
				RUN HOUR	Enable Run Hour	
			dLY			Digital input 2 detection delay time
			EdgE			Digital input 2 detection edge
	RISING			Detection in rising edge		
	FALLING			Detection in falling edge (Only valid for counter)		
	BOTH EDG			Detection in both edges (Only valid for counter)		
	PULSE					
						Pulse output 1 setup
						Pulse output 1 parameter setup
		OUT		OFF	Off	
			IMP ACT1	Assign to tariff 1 import active energy counter		
			EXP ACT1	Assign to tariff 1 export active energy counter		
			IMP REA1	Assign to tariff 1 import reactive energy counter		
EXP REA1			Assign to tariff 1 export reactive energy counter			
IMP ACT2			Assign to tariff 2 import active energy counter			
EXP ACT2			Assign to tariff 2 export active energy counter			
IMP REA2	Assign to tariff 2 import reactive energy counter					
EXP REA2	Assign to tariff 2 export reactive energy counter					

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description		
SETTINGS	PULSE	OUT1	OUT	DIN1	Assign to digital input 1 counter		
				DIN2	Assign to digital input 2 counter		
			durA	Pulse duration of the pulse output 1			
			rAt	Step range for pulse output 1			
		OUT2	OUT				Pulse duration of the pulse output 2
							Step range for pulse output 2
				OFF	Off		
				IMP ACT1	Assign to tariff 1 import active energy counter		
				EXP ACT1	Assign to tariff 1 export active energy counter		
				IMP REA1	Assign to tariff 1 import reactive energy counter		
				EXP REA1	Assign to tariff 1 export reactive energy counter		
				IMP ACT2	Assign to tariff 2 import active energy counter		
				EXP ACT2	Assign to tariff 2 export active energy counter		
				IMP REA2	Assign to tariff 2 import reactive energy counter		
				EXP REA2	Assign to tariff 2 export reactive energy counter		
				DIN1	Assign to digital input 1 counter		
				DIN2	Assign to digital input 2 counter		
				durA	Pulse duration of the pulse output 2		
				rAt	Step range for pulse output 2		
	SECURITY		Act			Password protection setup	
						Enable/disable password protection	
				NO	password protection disable		
			YES	password protection enable			
			Pin.t	Timeout for password protection. If you do press any keys after entering the password or do not change any settings via MODBUS, password protection is re-enabled after the time has elapsed.			
	Pin	Password value					
	DISPLAY	MENU				Secreen setup	
						Menu setup	
					ScrL		Menu scroll setup
						OFF	Menu scroll disable
						ON	Menu scroll enable
					Scr.P	Menu display time	
					Strt		Home page setup
						VOLTAGELN	Home page Voltage(L-N)
VOLTAGELL						Home page Voltage(L-L)	
CURRENT						Home page Current	

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description	
SETTINGS	DISPLAY	MENU	Strt	I NEUTR	Home page Neutral Current	
				COSQ	Home page CosQ	
				PF	Home page Power Factor	
				POWER P	Home page Active Power	
				POWER Q	Home page Reactive Power	
				POWER S	Home page Apperant Power	
				$\Sigma$ P-Q-S	Home page Total Power	
				FREQ	Home page Frequency	
				THD V	Home page THDV	
				THD I	Home page THDI	
	BACKLGH			oPt		Display backlight setup
						Display backlight options
					TIME DEP	Display backlight depending on the time
					CONT ON	Display backlight always on
					CONT OFF	Display backlight always off
						Display backlight always on time
	CLEAR					Clear Menu
					CLr	
					OFF	Clear abort
					ALL	Reset the device to factory settings
					ENERGY	Clear the energy counters
					COUNTERS	Clear the counters
					MAX VALS	Clear the max. values
					MIN VALS	Clear the min. values
					DEMANDS	Clear the demand values
					SETTINGS	Reset the setup to factory settings
	INFO					Information
UEr					Firmware version information	

### 3.5.1 Basic Settings Menu (BASIC)

This is the menu item where you make the current transformer ratio, voltage transformer ratio and connection type settings. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the menu tree and Section 5 for the factory default settings.

**Current transformer ratio (Ctr):** The calculated currents are multiplied by the current transformer ratio (Ctr) to be indicated on the displays and the modbus addresses.

**Voltage transformer ratio (Utr):** The calculated voltages are multiplied by the voltage transformer ratio (Utr) to be indicated on the displays and the modbus addresses.

**Connection (Conn):** This menu is for the network connection settings.

If "3P4W" (3-phase, 4-wire connection type) was specified for the network connection setup, the initial menu is "Voltage (Phase-Neutral)". This menu is displayed first when the device is energized.

If "3P3W" (3-phase, 3-wire connection type) was specified for the network connection setup, the initial menu is "Voltage (Phase-Phase)". This menu is displayed first when the device is energized.

### 3.5.2 Alarm Settings Menu (ALARMS)(KLEA 220P / KLEA 220P-DC / POWYS 3121)

Use this menu item to set the alarm limits, hysteresis value and alarm delay time. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.



Outside the alarm limits:

- The values which are belong to adjusted alarm parameter, start flashing.
- When alarm delay time is expired, ((⚠)) symbol is displayed in main screen.
- If relay outputs are assigned to any alarm and also if there is an alarm in the system, related relay symbols ( $\{ \}_{1}$ ,  $\{ \}_{2}$ ) are displayed in the main screen after alarm delay time.

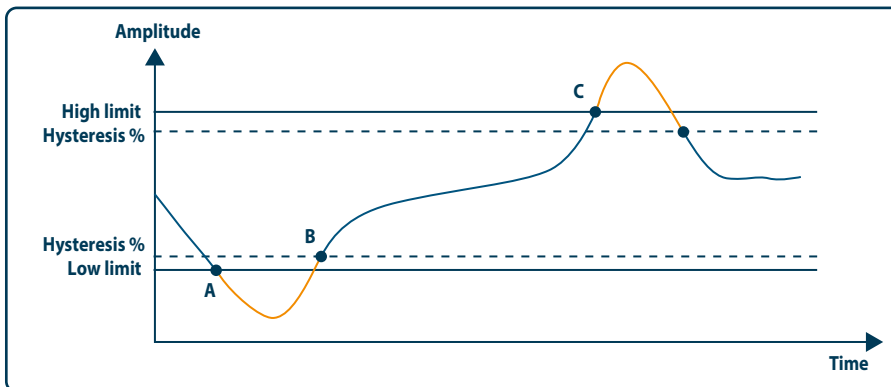


Figure 3-6 Alarm Example

- A low limit alarm occurs at point A.
- Alarm disappears at point B.
- A high limit alarm occurs at point C.
- Alarm disappears at point D.



### 3.5.3 Alarm Relay Settings Menu (RELAYS)(KLEA 220P / KLEA 220P-DC / POWYS 3121)

Use this menu item to set the conditions of the alarm relays. You can set both alarm relays to the following positions:

- OFF : Relay does not energize in an alarm condition.
- LO : Relay energizes when a low limit alarm occurs.
- HI : Relay energizes when a high limit alarm occurs.

Related relay is de-energized when the alarm condition ends. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings

### 3.5.4 Demand Period Setting Menu (DEMAND)

Use this menu item to setup the demand period. At the end of the specified period, demand values are calculated in a periodic cycle.

Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.

### 3.5.5 RS485 Settings Menu (RS485)

Use this menu item to set the baudrate, slave ID and parity control settings in RS485 communication. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.

**Baudrate (bAud):** Communication Signal speed is expressed with "baud" in terms of units. The baud rate can be changed in the adjustment range.

**Slave ID (Id):** RS485 communication is working on the basis of one or more slave devices communicate with one master. KLEA, as a slave in the RS485 communication responds to queries made by the master. If the device is slave match in this communication are set in the slave ID Menu.

**Parity Check (PrtY):** It is a control mechanism for data accuracy. It counts odds "1" in Binary data. There are "odd" and "even" parity control method. For communication, master and slave devices must be using the same method. The desired method is selected from the menu or "NONE" option selected to make parity check feature turned off.



### 3.5.6 Digital Input Settings Menu (DI INPUT)

Use this menu item to set the on/off position, type, delay time and detection edge for the digital input. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.



Digital input is based on dry contact detection principle. Never apply signal to inputs. Otherwise there is risk of damaging the device.

#### **Digital input type (tYPE):**

- Option to enable tariff 2 (TARIFF 2): If you choose this option for the digital input type, tariff2 energy counters will be enabled when the digital input is active (dry contact must be applied from related DIN+ and DIN-).
- Option to enable the counter (COUNTER): If you choose this option for the digital input type, the counter will count the changes in the position of the digital input depending on the chosen detection edge.
  - If you choose rising edge detection (RISING) for the detection edge, the counter will increase by 1 on each activation of the dry contact that is connected to the digital input.
  - If you choose falling edge detection (FALLING) for the detection edge, the counter will increase by 1 on each de-activation of the dry contact that is connected to the digital input.
  - If you choose both edges detection (BOTH EDGE) for the detection edge, the counter will increase by 1 on each activation and de-activation of the dry contact that is connected to the digital input.
- Run Hour enable option (RUN HOUR): If you choose this option for the digital input type, the “run hour counter” start counting when the digital input is active.(Dry contact must be applied from related DIN+ and DIN-).

#### **Detection delay time (dLY):**

The input is enabled or disabled based on the detection delay time which is set to account for contact spikes or noise in the digital input.

#### **Detection edge (EdgE):**

Use this menu item to choose the position where the digital input is detected active or passive. This menu is available only for the digital input mode “counter”. Other options always use the rising edge detection.



### 3.5.7 Pulse Output Settings Menu (PULSE)

Use this menu item to specify the on/off position, output parameter, pulse duration and step range settings for the pulse outputs. You can freely choose the settings for each pulse output independent of each other. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.

The pulse output is activated with an increase in the predefined output parameter that is equal to each step range and deactivates after the predefined time.

#### **Output parameter setup (OUT):**

Use this menu item to set the parameter dependency of the output. The respective output is closed when you choose "OFF".

#### **Pulse duration setup (durA):**

Use this menu item to specify the time the pulse is active.

#### **Pulse step range (rAt):**

Use this menu to specify the smallest possible increase for the input parameter that will output a pulse.

### 3.5.8 Password Settings Menu (SECURITY)

Use this menu item to turn the password protection on/off, set a password activation time and change password settings editing options. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.

4 digit password protects the product setup and counter menus against unauthorized access and modifications. When activated, a password query screen is displayed if someone attempts to change the values. After a successful login, the device will not ask for a password until the "password activation time" has elapsed. You can set this value in the respective menu item. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.



If you do not press any keys after entering the password or do not change the settings via MODBUS, password protection is re-enabled after the password activation time has elapsed.

### 3.5.9 Display Setup (DISPLAY)

The settings about menu screen and backlight are made in this menu.

#### **Menu Setup (MENU):**

Menu scroll setting, display time and start page are made in this sub-menu.

- **Menu scroll setup (ScrL):** Menu Navigation is given as a name to command which is moving menu screen to next one at the end of display time. If "ON" is selected, Menu navigation is activated after device start or 15 seconds after the last key is pressed.

- **Menu display period (Scr.P):** Each menu appears in the screen during the period that is adjusted in "menu display time". The unit is second and it is effective when menu scroll mode is "on". It is ineffective when menu scroll mode is "off".

- **Home page setup (Strt):** When the device is first energized, first screen menu is called Menu opening page. Any of this menu can be set from available instantaneous measurements Menu as Home page. Pre value "VOLTAGELN" menu is designated as Home page.

### **Display Backlight Setup (BACKLGH)**

Is subhead which lets adjustment of display backlight options and duration of backlight.

- **Display backlight options (oPt):** This menu is adjustment of display backlight activation depending on the time (TIME DEP), always on (CONT ON) or permanently closed (CONT OFF).

Time Dependent (TIME DEP): Backlight is turned on with device operates or with a pressing any key. Display backlight will be turned off if there is no pressing any key after set time. It is preferred to have longer-lasting power -saving and LED lighting.

- **Continuous ON (CONT ON):** Display backlight stays on permanently.
  - **Continuous OFF (CONT OFF):** Display backlight is permanently closed.
  - **Display Backlight On Time (durA):** Menu is where screen backlight time period is set with unit of second.
- **Display Backlight On Time (durA):** Menu is where screen backlight time period is set with unit of second.

### **3.5.10 Clear Menu (CLEAR)**

Use this menu to delete the stored values in the memory and restore the factory settings. Please see [Table 3-3](#) for the menu tree and [SECTION 5](#) for the factory default settings.

The following options are available in the clear menu:

- OF : Disables the clear process.
- ALL : Clears all values stored in the memory and restores them to the default factory settings.
- ENERGY : Resets all energy counters.
- COUNTERS : Resets all counters.
- MAX VALS : Clears the maximum values stored in the memory.
- MIN VALS : Clears the minimum values stored in the memory.
- DEMAND : Clears the demand values stored in the memory.
- SETTINGS : Restores all settings to the factory settings
- ALARMS : Restores the alarm settings to the factory settings.(KLEA 220P / KLEA 220P-DC / POWYS 3121-3122)



In order to prevent an accidental deletion, "nO" / "YES" prompt is displayed if you choose any option other than "OFF" [3.6.3 Approval Prosedure](#)

- To confirm the action:

Press the right key to blink the "NO" sign. Use the up/down keys to change the "NO" to "YES". Then, press the left key to confirm the action.

- To discard the action:

Press the right key to blink the "NO" sign. Then, press the left key to confirm the "NO" option and exit the menu without making any deletions.




The device restarts if you choose SETTINGS, ALARM(KLEA 220P / KLEA 220P-DC / POWYS 3121) or All and confirm the action. It will not restart if you choose other options. It will clear the values and returns back to the CLEAR menu.

## 3.6 Save, Changing Value and Approval Prosedure

### 3.6.1 Changing Value/Setting

# SETTINGS

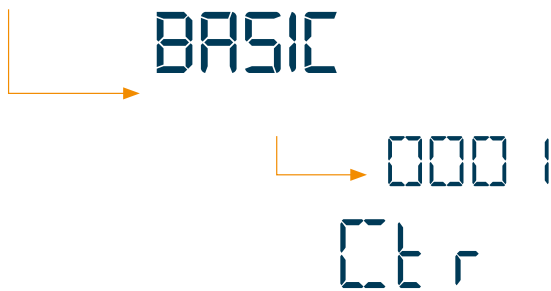

Menu titles in the menu "SETTINGS" are displayed in the menu bar. When the submenus are entered into, the menu in which the change will occur is shown in the indicator in the first row and the value belonging the related setting is shown in the menu bar and the change may be made here.

There are 2 different menus for changing the values:

- **Multiple choice menus:** These menus contain predefined options. Press the right key to choose and blink the first variable of the menu. Press the up/down keys to choose and blink the desired option. Then press the left button to complete your choice.
- **Menus with numerical input values:** In these menus, move through the digits to set the desired value. Press the right key to choose and blink the first digit of the variable from the left. Use the right key to move through the digits. Use the up/down keys to increase/decrease the value of the active digit. Set the desired values for variables by setting the individual digit values and press the left key to complete your action.



If any change is made on settings, a registration procedure which is questioning whether or not to record the change will be active after return to " settings" menu. If the changes are saved, device restarts. See: [3.6.2 Save Prosedure](#)

### 3.6.2 Save Prosedure

Press the left key until you see the "SAUE" display to confirm or discard the changes you made.

To confirm the changes:

YES  
SAVE

Press the right key to blink the "NO" sign. Use the up/down keys to change the "NO" to "YES". Then, press the left key to store the changes.

Değişiklikler reddedilecekse:

NO  
SAVE

Press the right key to blink the "NO" sign. Then exit the menu using the left key without saving your changes.



### 3.6.3 Approval Procedure

Following query screen comes up to confirm the action or to reject. To confirm the changes:



Press the right key to blink the "NO" sign. Use the up/down keys to change the "NO" to "YES". Then, press the left key to store the changes.

To discard the changes:



Press the right key to blink the "NO" sign. Then exit the menu using the left key without saving your changes.



In the Delete Menu SETTINGS ALL or ALARMS(KLEA 220P / KLEA 220P-DC / POWYS 3121) option shuts down the device after the approval of the selected transactions will be reopened. Other options for the restart process is not performed. The device returns to the CLEAR menu and perform the deletion



**KLEA**  
220P  
**POWYS**  
3121-3122  
Energy  
Analyzer

**SECTION 4**  
**RS485**  
**COMMUNICATION**



## SECTION 4 RS485 COMMUNICATION

### 4.1 Readable and Writable Data

The following functions are supported:

- **Function 03H:** This function reads the readable addresses in the modbus table.
- **Function 10H:** This function writes to the writable addresses in the modbus table.

Specifications:

- R / W : Can read and write the value in this address.
- RO : Can only read the value in this address.
- WO : Can only write to this address
- float : 32 bit floating number.

Related modbus table is given below:

**NOTE: The counter readings for POWYS 3122 are calculated by dividing by 100.**

Table 4-1 Readable and Writable Data

Adress	Parametre	Type	Read / Write	Write Condition
<b>Faz 1 Basic Measurements</b>				
0	Phase 1 Voltage (L-N)	float	RO	
2	Phase 1-2 Voltage (L-L)	float	RO	
4	Phase 1 Current	float	RO	
6	Phase 1 Cosφ	float	RO	
8	Phase 1 Power Factor	float	RO	
10	Phase 1 Active Power	float	RO	
12	Phase 1 Reactive Power	float	RO	
14	Phase 1 Apparent Power	float	RO	
16	Phase 1 THDV	float	RO	
18	Phase 1 THDI	float	RO	
<b>Phase -2 Basic Measurements</b>				
20	Phase 2 Voltage (L-N)	float	RO	
22	Phase 2-3 Voltage (L-L)	float	RO	
24	Phase 2 Current	float	RO	
26	Phase 2 Cosφ	float	RO	
28	Phase 2 Power Factor	float	RO	
30	Phase 2 Active Power	float	RO	
32	Phase 2 Reactive Power	float	RO	
34	Phase 2 Apparent Power	float	RO	
36	Phase 2 THDV	float	RO	
38	Phase 2 THDI	float	RO	



Adress	Parametre	Type	Read / Write	Write Condition
<b>Phase -3 Basic Measurements</b>				
40	Phase 3 Voltage (L-N)	float	RO	
42	Phase 3-1 Voltage (L-L)	float	RO	
44	Phase 3 Current	float	RO	
46	Phase 3 Cosφ	float	RO	
48	Phase 3 Power Factor	float	RO	
50	Phase 3 Active Power	float	RO	
52	Phase 3 Reactive Power	float	RO	
54	Phase 3 Apparent Power	float	RO	
56	Phase 3 THDV	float	RO	
58	Phase 3 THDI	float	RO	
<b>Common Measurements (Phase-1, Phase-2, Phase-3)</b>				
60	Average Voltage (L-N)	float	RO	
62	Average Voltage (L-L)	float	RO	
64	Total Current	float	RO	
66	System Power Factor	float	RO	
68	Total Active Power	float	RO	
70	Total Reactive Power	float	RO	
72	Total Apparent Power	float	RO	
74	System Frequency	float	RO	
76	Neutral Current	float	RO	
<b>Phase-1 Voltage Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
78	Phase 1 Voltage Harmonics 1	float	RO	
80	Phase 1 Voltage Harmonics 3	float	RO	
82	Phase 1 Voltage Harmonics 5	float	RO	
84	Phase 1 Voltage Harmonics 7	float	RO	
86	Phase 1 Voltage Harmonics 9	float	RO	
88	Phase 1 Voltage Harmonics 11	float	RO	
90	Phase 1 Voltage Harmonics 13	float	RO	
92	Phase 1 Voltage Harmonics 15	float	RO	
94	Phase 1 Voltage Harmonics 17	float	RO	
96	Phase 1 Voltage Harmonics 19	float	RO	
98	Phase 1 Voltage Harmonics 21	float	RO	
100	Phase 1 Voltage Harmonics 23	float	RO	
102	Phase 1 Voltage Harmonics 25	float	RO	
104	Phase 1 Voltage Harmonics 27	float	RO	
106	Phase 1 Voltage Harmonics 29	float	RO	
108	Phase 1 Voltage Harmonics 31	float	RO	
<b>Phase-1 Current Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
110	Phase 1 Current Harmonics 1	float	RO	



Adress	Parametre	Type	Read / Write	Write Condition
112	Phase 1 Current Harmonics 3	float	RO	
114	Phase 1 Current Harmonics 5	float	RO	
116	Phase 1 Current Harmonics 7	float	RO	
118	Phase 1 Current Harmonics 9	float	RO	
120	Phase 1 Current Harmonics 11	float	RO	
122	Phase 1 Current Harmonics 13	float	RO	
124	Phase 1 Current Harmonics 15	float	RO	
126	Phase 1 Current Harmonics 17	float	RO	
128	Phase 1 Current Harmonics 19	float	RO	
130	Phase 1 Current Harmonics 21	float	RO	
132	Phase 1 Current Harmonics 23	float	RO	
134	Phase 1 Current Harmonics 25	float	RO	
136	Phase 1 Current Harmonics 27	float	RO	
138	Phase 1 Current Harmonics 29	float	RO	
140	Phase 1 Current Harmonics 31	float	RO	
<b>Phase-2 Voltage Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
142	Phase 2 Voltage Harmonics 1	float	RO	
144	Phase 2 Voltage Harmonics 3	float	RO	
146	Phase 2 Voltage Harmonics 5	float	RO	
148	Phase 2 Voltage Harmonics 7	float	RO	
150	Phase 2 Voltage Harmonics 9	float	RO	
152	Phase 2 Voltage Harmonics 11	float	RO	
154	Phase 2 Voltage Harmonics 13	float	RO	
156	Phase 2 Voltage Harmonics 15	float	RO	
158	Phase 2 Voltage Harmonics 17	float	RO	
160	Phase 2 Voltage Harmonics 19	float	RO	
162	Phase 2 Voltage Harmonics 21	float	RO	
164	Phase 2 Voltage Harmonics 23	float	RO	
166	Phase 2 Voltage Harmonics 25	float	RO	
168	Phase 2 Voltage Harmonics 27	float	RO	
170	Phase 2 Voltage Harmonics 29	float	RO	
172	Phase 2 Voltage Harmonics 31	float	RO	
<b>Phase-2 Current Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
174	Phase 2 Current Harmonics 1	float	RO	
176	Phase 2 Current Harmonics 3	float	RO	
178	Phase 2 Current Harmonics 5	float	RO	
180	Phase 2 Current Harmonics 7	float	RO	
182	Phase 2 Current Harmonics 9	float	RO	
184	Phase 2 Current Harmonics 11	float	RO	
186	Phase 2 Current Harmonics 13	float	RO	



Adress	Parametre	Type	Read / Write	Write Condition
188	Phase 2 Current Harmonics 15	float	RO	
190	Phase 2 Current Harmonics 17	float	RO	
192	Phase 2 Current Harmonics 19	float	RO	
194	Phase 2 Current Harmonics 21	float	RO	
196	Phase 2 Current Harmonics 23	float	RO	
198	Phase 2 Current Harmonics 25	float	RO	
200	Phase 2 Current Harmonics 27	float	RO	
202	Phase 2 Current Harmonics 29	float	RO	
204	Phase 2 Current Harmonics 31	float	RO	
<b>Phase-3 Voltage Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
206	Phase 3 Voltage Harmonics 1	float	RO	
208	Phase 3 Voltage Harmonics 3	float	RO	
210	Phase 3 Voltage Harmonics 5	float	RO	
212	Phase 3 Voltage Harmonics 7	float	RO	
214	Phase 3 Voltage Harmonics 9	float	RO	
216	Phase 3 Voltage Harmonics 11	float	RO	
218	Phase 3 Voltage Harmonics 13	float	RO	
220	Phase 3 Voltage Harmonics 15	float	RO	
222	Phase 3 Voltage Harmonics 17	float	RO	
224	Phase 3 Voltage Harmonics 19	float	RO	
226	Phase 3 Voltage Harmonics 21	float	RO	
228	Phase 3 Voltage Harmonics 23	float	RO	
230	Phase 3 Voltage Harmonics 25	float	RO	
232	Phase 3 Voltage Harmonics 27	float	RO	
234	Phase 3 Voltage Harmonics 29	float	RO	
236	Phase 3 Voltage Harmonics 31	float	RO	
<b>Phase-2 Current Harmonic Measurements (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
238	Phase 3 Current Harmonics 1	float	RO	
240	Phase 3 Current Harmonics 3	float	RO	
242	Phase 3 Current Harmonics 5	float	RO	
244	Phase 3 Current Harmonics 7	float	RO	
246	Phase 3 Current Harmonics 9	float	RO	
248	Phase 3 Current Harmonics 11	float	RO	
250	Phase 3 Current Harmonics 13	float	RO	
252	Phase 3 Current Harmonics 15	float	RO	
254	Phase 3 Current Harmonics 17	float	RO	
256	Phase 3 Current Harmonics 19	float	RO	
258	Phase 3 Current Harmonics 21	float	RO	
260	Phase 3 Current Harmonics 23	float	RO	
262	Phase 3 Current Harmonics 25	float	RO	





Adress	Parametre	Type	Read / Write	Write Condition
264	Phase 3 Current Harmonics 27	float	RO	
266	Phase 3 Current Harmonics 29	float	RO	
268	Phase 3 Current Harmonics 31	float	RO	
<b>Phase-1 Maximum Measurements</b>				
270	Phase 1 Max. Voltage (L-N)	float	RO	
272	Phase 1-2 Max. Voltage (L-L)	float	RO	
274	Phase 1 Max. Current	float	RO	
276	Phase 1 Max. Cosφ	float	RO	
278	Phase 1 Max. Power Factor	float	RO	
280	Phase 1 Max. Active Power	float	RO	
282	Phase 1 Max. Reactive Power	float	RO	
284	Phase 1 Max. Apparent Power	float	RO	
286	Phase 1 Max. THDV	float	RO	
288	Phase 1 Max. THDI	float	RO	
<b>Phase-2 Maximum Measurements</b>				
290	Phase 2 Max. Voltage (L-N)	float	RO	
292	Phase 2-3 Max. Voltage (L-L)	float	RO	
294	Phase 2 Max. Current	float	RO	
296	Phase 2 Max. Cosφ	float	RO	
298	Phase 2 Max. Power Factor	float	RO	
300	Phase 2 Max. Active Power	float	RO	
302	Phase 2 Max. Reactive Power	float	RO	
304	Phase 2 Max. Apparent Power	float	RO	
306	Phase 2 Max. THDV	float	RO	
308	Phase 2 Max. THDI	float	RO	
<b>Phase-3 Maximum Measurements</b>				
310	Phase 3 Max. Voltage (L-N)	float	RO	
312	Phase 3-1 Max. Voltage (L-L)	float	RO	
314	Phase 3 Max. Current	float	RO	
316	Phase 3 Max. Cosφ	float	RO	
318	Phase 3 Max. Power Factor	float	RO	
320	Phase 3 Max. Active Power	float	RO	
322	Phase 3 Max. Reactive Power	float	RO	
324	Phase 3 Max. Apparent Power	float	RO	
326	Phase 3 Max. THDV	float	RO	
328	Phase 3 Max. THDI	float	RO	
<b>Maximum Common Measurements (Phase-1, Phase-2, Phase-3)</b>				
330	Max. Average Voltage (L-N)	float	RO	



Adress	Parametre	Type	Read / Write	Write Condition
332	Max. Average Voltage (L-L)	float	RO	
334	Max. Total Current	float	RO	
336	Max. System Power Factor	float	RO	
338	Max. Total Active Power	float	RO	
340	Max. Total Reactive Power	float	RO	
342	Max. Total Apparent Power	float	RO	
344	Max. System Frequency	float	RO	
346	Max. Neutral Current	float	RO	
<b>Phase-1 Maximum Measurements</b>				
348	Phase 1 Min. Voltage (L-N)	float	RO	
350	Phase 1-2 Min. Voltage (L-L)	float	RO	
352	Phase 1 Min. Current	float	RO	
354	Phase 1 Min. Cosφ	float	RO	
356	Phase 1 Min. Power Factor	float	RO	
358	Phase 1 Min. Active Power	float	RO	
360	Phase 1 Min. Reactive Power	float	RO	
362	Phase 1 Min. Apparent Power	float	RO	
364	Phase 1 Min. THDV	float	RO	
366	Phase 1 Min. THDI	float	RO	
<b>Phase-2 Maximum Measurements</b>				
368	Phase 2 Min. Voltage (L-N)	float	RO	
370	Phase 2-3 Min. Voltage (L-L)	float	RO	
372	Phase 2 Min. Current	float	RO	
374	Phase 2 Min. Cosφ	float	RO	
376	Phase 2 Min. Power Factor	float	RO	
378	Phase 2 Min. Active Power	float	RO	
380	Phase 2 Min. Reactive Power	float	RO	
382	Phase 2 Min. Apparent Power	float	RO	
384	Phase 2 Min. THDV	float	RO	
386	Phase 2 Min. THDI	float	RO	
<b>Phase-3 Maximum Measurements</b>				
388	Phase 3 Min. Voltage (L-N)	float	RO	
390	Phase 3-1 Min. Voltage (L-L)	float	RO	
392	Phase 3 Min. Current	float	RO	
394	Phase 3 Min. Cosφ	float	RO	
396	Phase 3 Min. Power Factor	float	RO	
398	Phase 3 Min. Active Power	float	RO	
400	Phase 3 Min. Reactive Power	float	RO	
402	Phase 3 Min. Apparent Power	float	RO	
404	Phase 3 Min. THDV	float	RO	



Address	Parametre	Type	Read / Write	Write Condition
406	Phase 3 Min. THDI	float	RO	
<b>Minimum Common Measurements (Phase-1, Phase-2, Phase-3)</b>				
408	Min. Average Voltage (L-N)	float	RO	
410	Min. Average Voltage (L-L)	float	RO	
412	Min. Total Current	float	RO	
414	Min. System Power Factor	float	RO	
416	Min. Total Active Power	float	RO	
418	Min. Total Reactive Power	float	RO	
420	Min. Total Apparent Power	float	RO	
422	Min. System Frequency	float	RO	
424	Min. Neutral Current	float	RO	
<b>Alarm Flags (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
426	Alarm Flags	32 bit integer	RO	See Table 4.2
<b>Demand Measurements</b>				
428	Phase 1 Current Demand	float	RO	
430	Phase 2 Current Demand	float	RO	
432	Phase 3 Current Demand	float	RO	
434	Total Current Demand	float	RO	
436	Phase 1 Active Power Demand	float	RO	
438	Phase 2 Active Power Demand	float	RO	
440	Phase 3 Active Power Demand	float	RO	
442	Total Active Power Demand	float	RO	
444	Phase 1 Reactive Power Demand	float	RO	
446	Phase 2 Reactive Power Demand	float	RO	
448	Phase 3 Reactive Power Demand	float	RO	
450	Total Reactive Power Demand	float	RO	
452	Phase 1 Apparent Power Demand	float	RO	
454	Phase 2 Apparent Power Demand	float	RO	
456	Phase 3 Apparent Power Demand	float	RO	
458	Total Apparent Power Demand	float	RO	
<b>Digital Input</b>				
460	Digital Input 1 Counter	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
462	Digital Input 2 Counter	32 bit integer	R / W	
464	Run Hour Counter	32 bit integer	R / W	
466	On Hour Counter	32 bit integer	RO	
468	Power Interruptions Counter	32 bit integer	RO	



Adress	Parametre	Type	Read / Write	Write Condition
<b>Energy Meters</b>				
<b>Tariff 1 Total Energy Values (Phase1+Phase2+Phase3)</b>				
470	Import Active Energy T1 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
472	Export Active Energy T1 (Tariff 1)	32 bit integer	R / W	
474	Import Reactive Energy T1 (Tariff 1)	32 bit integer	R / W	
476	Export Reactive Energy T1 (Tariff 1)	32 bit integer	R / W	
<b>Tariff 2 Total Energy Values (Phase1+Phase2+Phase3)</b>				
478	Import Active Energy T2 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
480	Export Active Energy T2 (Tariff 2)	32 bit integer	R / W	
482	Import Reactive Energy T2 (Tariff 2)	32 bit integer	R / W	
484	Export Reactive Energy T2 (Tariff 2)	32 bit integer	R / W	
<b>Tariff 1 Phase 1 Energy Values</b>				
486	Import Active Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
488	Export Active Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
490	Import Reactive Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
492	Export Reactive Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
<b>Tariff 1 Phase 2 Energy Values</b>				
494	Import Active Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
496	Export Active Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
498	Import Reactive Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
500	Export Reactive Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
<b>Tariff 1 Phase 3 Energy Values</b>				
502	Import Active Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
504	Export Active Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
506	Import Reactive Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
508	Export Reactive Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
<b>Tariff 2 Phase 1 Energy Values</b>				
510	Import Active Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
512	Export Active Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	
514	Import Reactive Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	
516	Export Reactive Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	
<b>Tariff 2 Phase 2 Energy Values</b>				
518	Import Active Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
520	Export Active Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
522	Import Reactive Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
524	Export Reactive Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
<b>Tariff 2 Phase 3 Energy Values</b>				
526	Import Active Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
528	Export Active Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	
530	Import Reactive Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	
532	Export Reactive Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	



Adress	Parametre	Type	Read / Write	Write Condition
<b>Device Settings</b>				
534	Current Transfer Rate (CTR)	32 bit integer	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
536	Voltage Transfer Rate (VTR)	float	R / W	
538	Connection Type	32 bit integer	R / W	
540	Relay 1 Function(KLEA 220P / KLEA 220P-DC / POWYS 3121)	32 bit integer	R / W	
542	Relay 2 Function(KLEA 220P / KLEA 220P-DC / POWYS 3121)	32 bit integer	R / W	
544	Demand Time	32 bit integer	R / W	
546	Password Enable	32 bit integer	R / W	
548	Password Activation Time	32 bit integer	R / W	
550	Password Value	32 bit integer	R / W	
552	Baud Rate	32 bit integer	R / W	
554	Slave ID	32 bit integer	R / W	
556	Parity Control	32 bit integer	R / W	
558	Digital Input 1 Type	32 bit integer	R / W	
560	Digital Input 1 Delay Time	32 bit integer	R / W	
562	Digital Input 1 Edge	32 bit integer	R / W	
564	Digital Input 2 Type	32 bit integer	R / W	
566	Digital Input 2 Delay Time	32 bit integer	R / W	
568	Digital Input 2 Edge	32 bit integer	R / W	
570	Pulse Output 1 Parameter	32 bit integer	R / W	
572	Pulse Output 1 Duration	32 bit integer	R / W	
574	Pulse Output 1 Rate	32 bit integer	R / W	
576	Pulse Output 2 Parameter	32 bit integer	R / W	
578	Pulse Output 2 Duration	32 bit integer	R / W	
580	Pulse Output 2 Rate	32 bit integer	R / W	
582	Menu Scroll On/Off	32 bit integer	R / W	
584	Menu Display Period	32 bit integer	R / W	
586	Home page Setup	32 bit integer	R / W	
588	Display backlight options	32 bit integer	R / W	
590	Display backlight on time	32 bit integer	R / W	
<b>Alarm Settings (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
592	Voltage (L-N) Alarm High Limit	float	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
594	Voltage (L-N) Alarm Low Limit	float	R / W	
596	Voltage (L-N) Alarm Hysteresis	float	R / W	
598	Voltage (L-N) Alarm Delay Time	32 bit integer	R / W	
600	Voltage (L-L) Alarm High Limit	float	R / W	
602	Voltage (L-L) Alarm Low Limit	float	R / W	
604	Voltage (L-L) Alarm Hysteresis	float	R / W	
606	Voltage (L-L) Alarm Delay Time	32 bit integer	R / W	
608	Current Alarm High Limit	float	R / W	
610	Current Alarm Low Limit	float	R / W	
612	Current Alarm Hysteresis	float	R / W	
614	Current Alarm Delay Time	32 bit integer	R / W	
616	Neutral Current Alarm High Limit	float	R / W	
618	Neutral Current Alarm Low Limit	float	R / W	
620	Neutral Current Alarm Hysteresis	float	R / W	



Adress	Parametre	Type	Read / Write	Write Condition
622	Neutral Current Alarm Delay Time	32 bit integer	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
624	Cosφ Alarm High Limit	float	R / W	
626	Cosφ Alarm Low Limit	float	R / W	
628	Cosφ Alarm Hysteresis	float	R / W	
630	Cosφ Alarm Delay Time	32 bit integer	R / W	
632	Power Factor Alarm High Limit	float	R / W	
634	Power Factor Alarm Low Limit	float	R / W	
636	Power Factor Alarm Hysteresis	float	R / W	
638	Power Factor Alarm Delay Time	32 bit integer	R / W	
640	Frequency Alarm High Limit	float	R / W	
642	Frequency Alarm Low Limit	float	R / W	
644	Frequency Alarm Hysteresis	float	R / W	
646	Frequency Alarm Delay Time	32 bit integer	R / W	
<b>Device Model</b>				
648	Device Firmware Version	float	RO	
650	Device Model	32 bit integer	RO	
<b>Password /Pin activation</b>				
652	Setting protection	32 bit integer	R / W	Address for the device password. It displays the enabled/disabled condition of the password protection when reading using
<b>Reset Commands</b>				
1000	Reset Energy Values	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1" into the respective address to reset the values. Enter "0" before saving to restore the values.
1002	Reset Counter Values	32 bit integer	WO	
1004	Reset Max. Values	32 bit integer	WO	
1006	Reset Min. Values	32 bit integer	WO	
1008	Reset Demand Values	32 bit integer	WO	
1010	Reset Settings	32 bit integer	WO	
1012	Reset Alarm Limits(KLEA 220P / KLEA 220P-DC / POWYS 3121)	32 bit integer	WO	
1014	Reset the Device to Factory Settings	32 bit integer	WO	
<b>Save The Changes</b>				
2000	Save Changes	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1" to save the changes and restart.
<b>Manual Output Relay Control (KLEA 220P / KLEA 220P-DC / POWYS 3121)</b>				
4000	Enable Relay Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1111" here to enable the relay control. Enter "0" here to disable the relay control.
4002	Relay 1 Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Then, enter "1111" for the "Enable Relay Control" address. Enter "1" to activate, "0" to de-activate the relay.
4004	Relay 1 Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Then, enter "1111" for the "Enable Relay Control" address. Enter "1" to activate, "0" to de-activate the relay.



Adress	Parametre	Type	Read / Write	Write Condition
<b>Enable/Disable to Assigning Predefined Value for Energy Meters</b>				
5000	Enable Counter Change	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "2222" here to enable assigning the relay control. Enter "0" here to disable the meter assignment.

### 4.1.1 Status/Alarm Flags(KLEA 220P / KLEA 220P-DC / POWYS 3121)

“Alarm Flags” modbus address showing the alarm conditions and alarm conditions represented with bits are given below.

Table 4-2 Alarm Flags

458 Alarm Flags															
31	30	29	28	27	26	25	24	23	22	21	20	19	18	17	16
DI2 Status	DI1 Status	Relay 2 Status	Relay 2 Status	DO2 Status	DO1 Status	Reserve/OFF					SEQ	I3 OFF	I2 OFF	I1 OFF	V3 OFF
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
V2 OFF	V1 OFF	Freq Low	Freq High	PF Low	PF High	Cosφ Low	Cosφ High	I(Nötr) Low	I(Nötr) High	I Low	I High	V(L-L) Low	V(L-L) High	V(L-N) Low	V(L-N) High

bit	Description
31	: DI2 Status: Digital input 2 signal condition (active or passive)
30	: DI1 Status: Digital input 1 signal condition (active or passive)
29	: DI1 Status: Digital input 1 signal condition (active or passive)
28	: Relay 1 Status: Relay 1 active/pasive status
27	: DO2 Status: Digital Output 2 active/pasive status
26	: DO1 Status: Digital Output 1 active/pasive status
25-21	: Reserve
20	: SEQ - Phase Order Alarm
19	: I3 OFF - 3. No current in Line-3
18	: I2 OFF - 2. No current in Line-2
17	: I1 OFF - 1. No current in Line-1
16	: V3 OFF - 3. No voltage in Line-3
15	: V2 OFF - 2. No voltage Line-2
14	: V1 OFF - 1. No voltage in Line-1
13	: Freq Low - Low frequency alarm
12	: Freq High - High frequency alarm
11	: PF Low - Low power factor alarm
10	: PF High - High power factor alarm
9	: Cos $\phi$ Low - Low Cos $\phi$ alarm
8	: Cos $\phi$ High - High Cos $\phi$ alarm
7	: I(N) Low - Low neutral current alarm
6	: I(N) High - High neutral current alarm
5	: I Low - Low current alarm
4	: I High - High current alarm
3	: V(L-L) Low - Low phase-phase voltage alarm
2	: V(L-L) High - High phase-phase voltage alarm
1	: V(L-N) Low - Low phase-neutral voltage alarm
0	: V(L-N) High - High phase-neutral voltage alarm



If the device was not restarted after entering the password or the "password activation time" has not elapsed, this will read "0" to indicate that password protection is disabled in the "Settings protection" address(modbus adr: 604). In this case, you don't need to re-enter the password.  
 Password activation time resets and restarts each time a modbus write action is performed or a key is pressed.





## 4.2 Multiple Choice Settings via Modbus

Modbus addresses for the multiple choice settings, input values and their descriptions are given below.

Table 4-3 Description List

Address	register name	Write value	Description name
538	Connection Type	0	3P4W
		1	3P3W
540	Relay 1 Function (KLEA 220P / KLEA 220P-DC / POWYS 3121)	0	OFF
		1	LOW
		2	HIGH
542	Relay 2 Function (KLEA 220P / KLEA 220P-DC / POWYS 3121)	0	OFF
		1	LOW
		2	HIGH
546	Password Enable	0	OFF
		1	ON
552	Baud Rate	0	1200 baud
		1	2400 baud
		2	4800 baud
		3	9600 baud
		4	19200 baud
		5	38400 baud
		6	57600 baud
556	Party Control	0	NONE
		1	EVEN
		2	ODD
558	Digital Input 1 Type	0	OFF
		1	TARIFF 2
		2	COUNTER
562	Sayısal Giriş 1 Edge	0	RISING
		1	FALLING
		2	BOTH EDG
564	Sayısal Giriş 1 Edge	0	OFF
		1	TARIFF 2
		2	COUNTER
568	Digital Input 2 Edge	0	RISING
		1	FALLING
		2	BOTH EDG

Address	register name	Write value	Description name
570	Pulse Output 1 Parameter	0	OFF
		1	IMP ACT1
		2	EXP ACT1
		3	IMP REA1
		4	EXP REA1
		5	IMP ACT2
		6	EXP ACT2
		7	IMP REA2
		8	EXP REA2
		9	DIN1
		10	DIN2
576	Pulse Output 2 Parameter	0	OFF
		1	IMP ACT1
		2	EXP ACT1
		3	IMP REA1
		4	EXP REA1
		5	IMP ACT2
		6	EXP ACT2
		7	IMP REA2
		8	EXP REA2
		9	DIN1
		10	DIN2
582	Menu Scroll On/Of	0	OFF
		1	ON
586	Home Page Settings	0	VOLTAGE(L-N)
		1	VOLTAGE(L-L)
		2	CURRENT
		3	I NEUTR
		4	COSQ
		5	PF
		6	POWER P
		7	POWER Q
		8	POWER S
		9	$\Sigma$ P-Q-S
		10	FREQ
		11	THD V
		12	THD I
588	Display Backlights Options	0	TIME DEP
		1	CONT ON
		2	CONT OFF



**KLEA**

220P

**POWYS**

3121-3122

Energy  
Analyzer

**SECTION 5  
FACTORY  
DEFAULT  
SETTINGS**



## SECTION 5 FACTORY DEFAULT SETTINGS

Menu	Sub Menu 1	Sub Menu 2	Description	Default Value	Unit	Setting Range
<b>BASIC</b>	<b>Ctr</b>		Current transformer ratio	1	-	0.00 - 1.00
	<b>Utr</b>		Voltage transformer ratio	1.0	-	0.00 - 1.00
	<b>Conn</b>		Connection type options	3P4W	-	0.00 - 1.00
<b>ALARMS</b> (KLEA 220P / KLEA 220P-DC / POWYS 3121)	<b>VLN ALM</b>	<b>HI</b>	Voltage (phase-neutral) alarm high limit	0.0	V	0 - 60
		<b>LO</b>	Voltage (phase-neutral) alarm low limit	0.0	V	45.0 - 65.0
		<b>hYSt</b>	Voltage (phase-neutral) alarm hysteresis value	5.0	V	45.0 - 65.0
		<b>dIY.t</b>	Voltage (phase-neutral) alarm delay time	5	sn	0.0 - 20.0
	<b>VLL ALM</b>	<b>HI</b>	Voltage (phase-phase) alarm high limit	0.0	V	0 - 60
		<b>LO</b>	Voltage (phase-phase) alarm high low limit	0.0	V	OFF/LOW/HIGH
		<b>hYSt</b>	Voltage (phase-phase) alarm hysteresis value	5.0	V	OFF/LOW/HIGH
		<b>dIY.t</b>	Voltage (phase-phase) alarm delay time	5	sn	1 - 60
	<b>I ALM</b>	<b>HI</b>	Current alarm high limit	0.0	A	1200/2400/4800/9600/19200/38
		<b>LO</b>	Current alarm low limit	0.0	A	400/57600
		<b>hYSt</b>	Current alarm hysteresis value	0.1	A	1 - 247
		<b>dIY.t</b>	Current alarm delay value	5	sn	NONE/EVEN/ODD
	<b>IN ALM</b>	<b>HI</b>	Neutral current alarm high limit	0.0	A	OFF/TARIFF 2/COUNTER/RUN HOUR
		<b>LO</b>	Neutral current alarm low limit	0.0	A	10 - 2000
		<b>hYSt</b>	Neutral current hysteresis value	0.1	A	RISING/FALLING/BOTH EDG
		<b>dIY.t</b>	Neutral current alarm delay value	5	sn	OFF/TARIFF 2/COUNTER/RUN HOUR
	<b>COSQ ALM</b>	<b>HI</b>	cos $\phi$ alarm high limit	0.00	-	10 - 2000
		<b>LO</b>	cos $\phi$ alarm low limit	0.00	-	RISING/FALLING/BOTH EDG
		<b>hYSt</b>	cos $\phi$ alarm hysteresis value	0.01	-	0.00 - 1.00
		<b>dIY.t</b>	cos $\phi$ alarm delay time	5	sn	0 - 60



Menu	Sub Menu 1	Sub Menu 2	Description	Default Value	Unit	Setting Range
ALARMS (KLEA 220P / KLEA 220P-DC / POWYS 3121)	PF ALM	HI	Power factor alarm high limit	0.00	-	0.00 - 1.00
		LO	Power factor alarm low limit	0.00	-	0.00 - 1.00
		hYSt	Power factor alarm hysteresis value	0.01	-	0.00 - 1.00
		dIY.t	Power factor alarm delay time	5	sn	0 - 60
	FREQ ALM	HI	Frequency alarm high limit	50.0	Hz	45.0 - 65.0
		LO	Frequency alarm low limit	50.0	Hz	45.0 - 65.0
		hYSt	Frequency alarm hysteresis value	2.0	Hz	0.0 - 20.0
		dIY.t	Frequency alarm delay time	5	sn	0 - 60
RELAYS (KLEA 220P / KLEA 220P-DC / POWYS 3121)	rLY1		Relay 1 setup	OFF	-	OFF/LOW/HIGH
	rLY2		Relay 2 setup	OFF	-	OFF/LOW/HIGH
DEMAND	dEd.s		Demand time setup	15	dk	1 - 60
RS485	bAud		Baud rate options	38400	Baud	1200/2400/4800/9600/19200/38400/57600
	Id		Slave ID setup	1	-	1 - 247
	PrtY		Parity check setup	NONE	-	NONE/EVEN/ODD
DI INPUT	INPUT1	tYPE	Digital input 1 options	OFF	-	OFF/TARIFF 2/COUNTER/RUN HOUR
		dLY	Digital input 1 detection delay time	10	msn	10 - 2000
		EdgE	Digital input 1 detection edge	RISING	-	RISING/FALLING/BOTH EDG
	INPUT2	tYPE	Digital input 2 options	OFF	-	OFF/TARIFF 2/COUNTER/RUN HOUR
		dLY	Digital input 2 detection delay time	10	msn	10 - 2000
			Digital input 2 detection edge	RISING	-	RISING/FALLING/BOTH EDG
PULSE	OUT1	OUT	Pulse output 1 parameter setup	OFF	-	OFF / IMP ACT1 / EXP ACT1 / IMP REA1 / EXP REA1 / IMP ACT2 / EXP ACT2 / IMP REA2 / EXP REA2 / DIN1 / DIN2
		durA	Pulse duration of the pulse output 1	50	msn	50 - 2500
		rAt	Step range for pulse output 1	1	kWh/kVarh Qty	1 - 99 999 999
	OUT2	OUT	Pulse output 2 parameter setup	OFF	-	OFF / IMP ACT1 / EXP ACT1 / IMP REA1 / EXP REA1 / IMP ACT2 / EXP ACT2 / IMP REA2 / EXP REA2 / DIN1 / DIN2
		durA	Pulse duration of the pulse output 2	50	msn	50 - 2500
			Step range for pulse output 2	1	kWh / kVarh Qty	1 - 99 999 999



Menu	Sub Menu 1	Sub Menu 2	Description	Default Value	Unit	Setting Range
SIFRE	Act		Enable/disable password protection	NO	-	NO/YES
	Pin.t		Timeout for password protection	10	dk	1 - 60
	Pin		Change password	1	-	1 - 9999
DISPLAY	MENU	ScrL	Menu scroll on/off	OFF	-	OFF/ON
		Scr.P	Menu display time	3	sn	1 - 60
		Strt	Home page setup	VOLTAGE LN	-	VOLTAGELN / VOLTAGELL / CURRENT / I NEUTR / COSQ / PF / POWER P / POWER Q / POWER S / $\Sigma$ P-Q-S / FREQ / THD V / THD I
	BACKLGH	oPt	Display backlight options	TIME DEP	-	TIME DEP/CONT ON/CONT OFF
		durA	Display backlight on time	600	sn	10 - 600
CLEAR	CLr		Clear menu	OFF	-	OFF / ALL / ENERGY / COUNTERS / MAX VALS / MIN VALS / DEMANDS / SETTINGS / ALARMS



**KLEA**  
220P  
**POWYS**  
3121-3122  
Energy  
Analyzer

**SECTION 6  
TECHNICAL  
SPECIFICATIONS**



## SECTION 6 TECHNICAL SPECIFICATIONS

Supply		
Voltage	85..300 V AC/DC, 18..70 VDC(606190)	
Frequency	45..65Hz	
Power Consumption	< 4.5VA & <2W	
Measurement Inputs		
Voltage	5..300V AC (L - N)	
	10..500V AC (L - L)	
Current	10mA .. 6A AC	
Frequency	45..65Hz	
Network Connection Type	3 phase 4 wire, 3 phase 3 wire	
Digital Input		
Input Type	Dry Contact	
Isolation	5000V RMS	
Digital Output		
Output Type	Transistor	
Switching Voltage	5..30V DC	
Switching Current	50mA	
Isolation	5000V RMS	
Realy Output (KLEA 220P / KLEA 220P-DC / POWYS 3121)		
	<b>AC</b>	<b>DC</b>
Maximum Switching Voltage	250V	30V
Maximum Switching Current	10A	5A
Maximum Switching Power	1250VA	150W
General		
Operating Temperature	-20°C..+70°C	
Storage Temperature	-30°C..+80°C	
Protection Class	IP40	
Relative Humidity	%95 non-condensing	

**Measurement Accuracy**

Symbol	Measurement Type	Class According to IEC 61557-12	Measurement Range	Other Standards
$P$	Total Active Power	0,5	10 % $I_b \leq I \leq I_{max}$ 0,5 Ind to 0,8 Cap	-
$Q_V$	Total Reactive Power	1	5 % $I_b \leq I \leq I_{max}$ 0,25 Ind to 0,25 Cap	-
$tS_A$	Total Apparent Power	0,5	10 % $I_b \leq I \leq I_{max}$ 0,5 Ind to 0,8 Cap	-
$E_A$	Total Active Energy	0,5	0 - 99999999 kWh 0-99 999 99,9 kWh (POWYS 3122)	IEC 62053-22 Class 0.5S
$E_{rV}$	Total Reactive Energy	2	0 - 99999999 kVarh 0-99999 99,9 kVarh (POWYS 3122)	IEC 62053-23 Class 2
$f$	Frequency	0,1	45 – 65 Hz	-
$I$	Phase Current	0,5	20 % $I_b \leq I \leq I_{max}$	-
$I_{Nc}$	Neutral Current (Measured)	0,5	20 % $I_b \leq I \leq I_{max}$	-
$U$	Voltage	0,2	$U_{min} \leq U \leq U_{max}$	-
$PF_A$	Power Factor	0,5	0,5 Ind to 0,8 Cap	-
$THDV$	Total Harmonic Distortion Voltage	1	0 % to 20 %	-
$THDI$	Total Harmonic Distortion Current	1	0 % to 100 %	-



